




Pile Dynamics, Inc.

Transducer B994

Strain ($\mu\epsilon$)

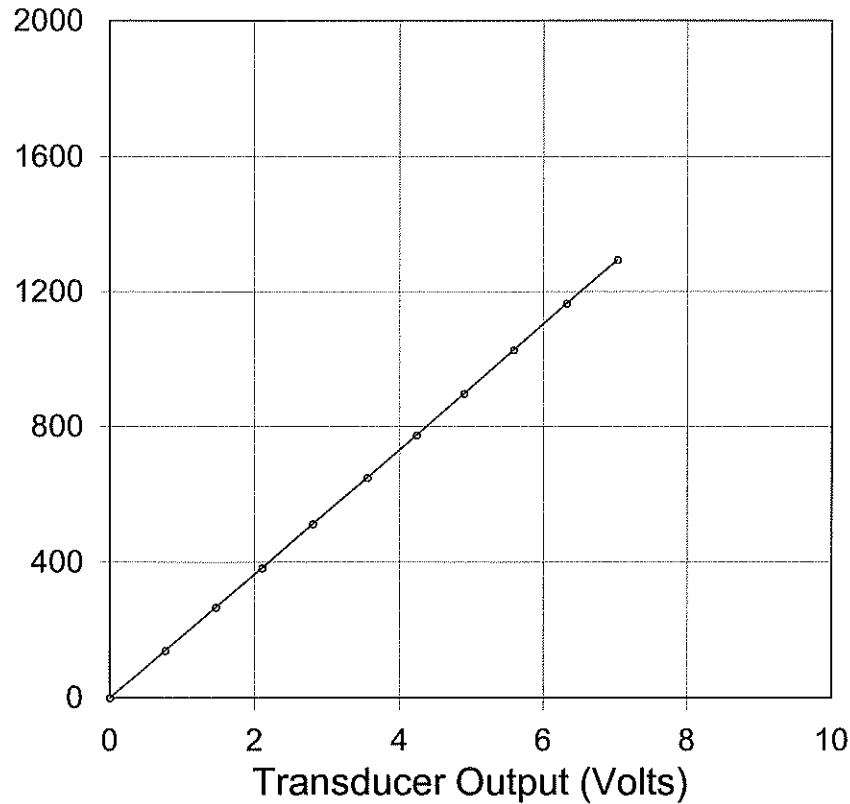

PDA Cal Factor (5.0 V)

92.2 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
141	0.76
267	1.46
383	2.10
512	2.80
648	3.55
775	4.23
897	4.89
1026	5.58
1167	6.32
1296	7.03

Shunt (60.4 K Ω)

2.5 V

General Factor

320.2 $\mu\epsilon$ /mV/V

Calibrated by:

Calibrated on:

Shah
03-Jan-2008

Traceable to N.I.S.T.