




Pile Dynamics, Inc.

Transducer B998

Strain ($\mu\epsilon$)

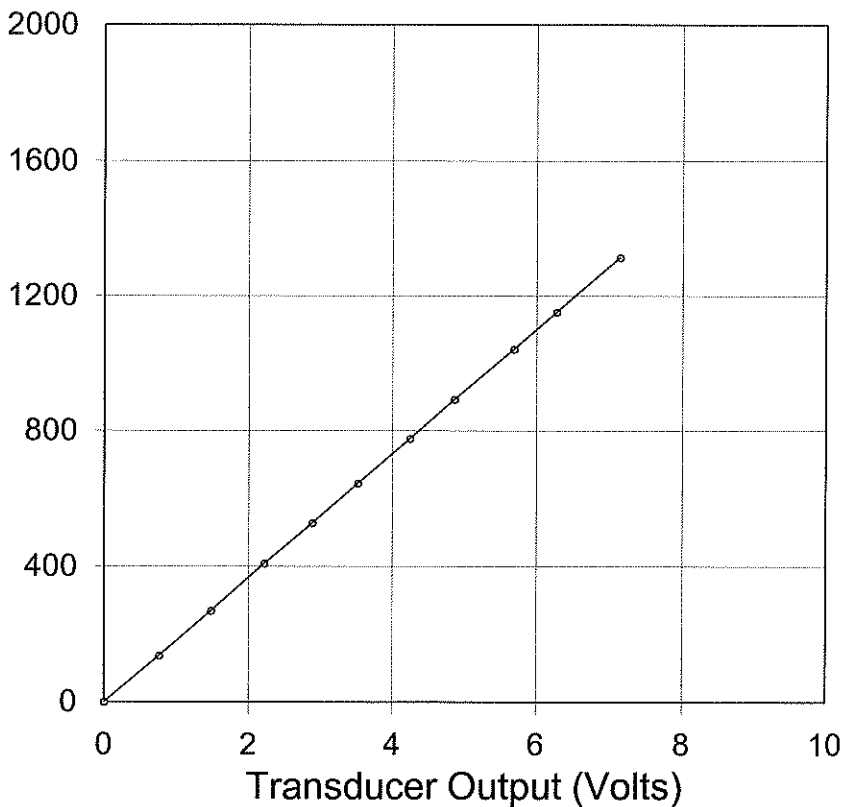

PDA Cal Factor (5.0 V)

91.9 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
138	0.75
270	1.47
408	2.21
528	2.88
643	3.51
777	4.24
892	4.86
1042	5.68
1153	6.27
1314	7.14

Shunt (60.4 K Ω)

2.5 V

General Factor

319.2 $\mu\epsilon$ /mV/V

Calibrated by:

Calibrated on:

[Signature]
03-Jan-2008

Traceable to N.I.S.T.