


Certificate of Calibration

Pile Dynamics, Inc.

Calibrated by Pile Dynamics, Inc.

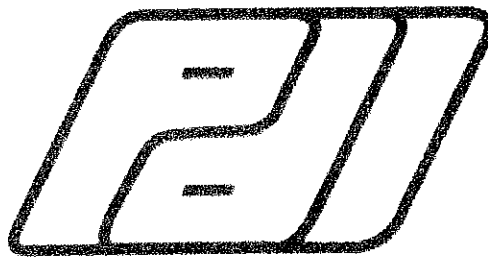

Serial No: 45792 Temperature: 23.0 °C

Model: PE Humidity: 28%

Calibrated on: Channel 3 on 8G 5161 LE

PDA CALIBRATION FACTOR

1183.9 g's/volt

R²: 0.999987 [No chip]

Ref Acc 1: 78268! Cal on: 11Jan2024
986 g's/volt

Ref Acc 2: 78270! Cal on: 11Jan2024
971 g's/volt


Operator: William Johnson

Signed

Reference accelerometer calibrations are traceable to the United States National Institute of Standards and Technology (NIST).

Calibration valid 2 years

From: 14Nov2025

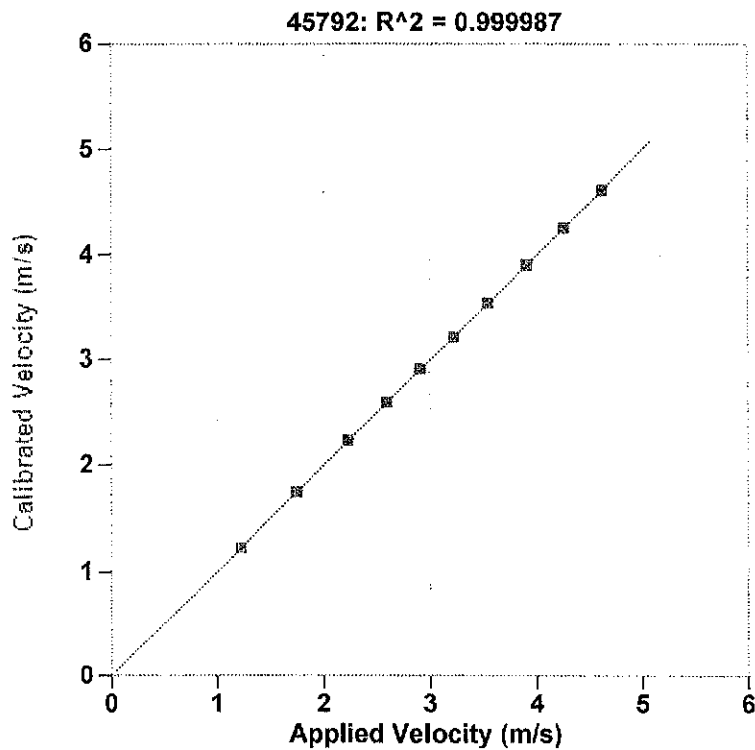

Reference Velocity	S/N 45792 Velocity
m/s	m/s
1.225	1.227
1.750	1.750
2.240	2.239
2.599	2.597
2.919	2.919
3.227	3.218
3.545	3.551
3.909	3.914
4.262	4.263
4.626	4.623

Maximum Acceleration: 1003 g's