




Pile Dynamics, Inc.

Transducer C028

Strain ($\mu\epsilon$)

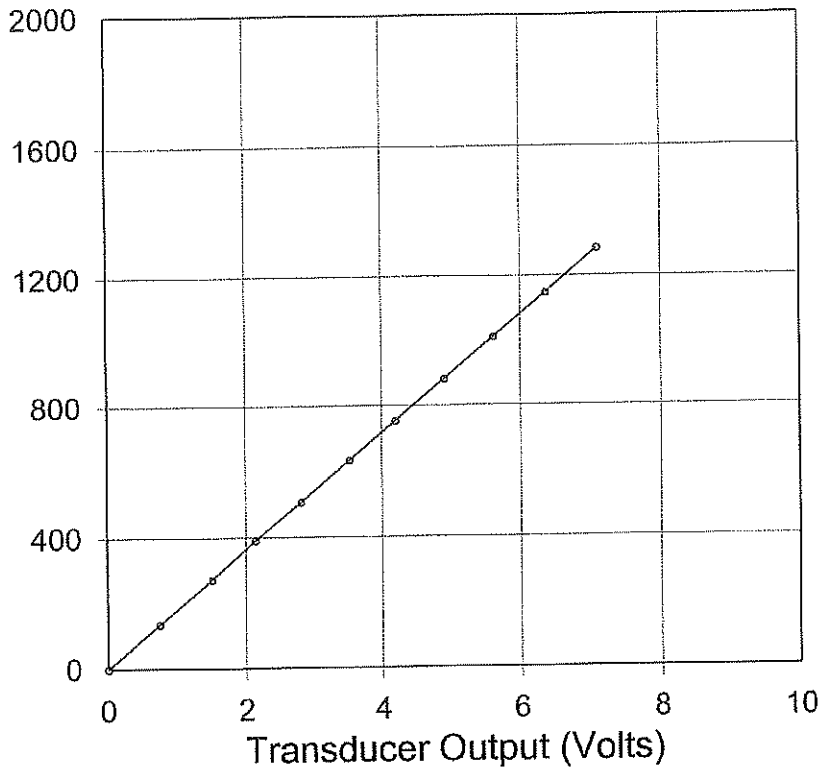

PDA Cal Factor (5.0 V) 90.2 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
138	0.74
272	1.50
390	2.14
505	2.81
632	3.52
752	4.19
881	4.90
1013	5.61
1149	6.36
1285	7.09

Shunt (60.4 K Ω)
General Factor

2.5 V
313.2 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:
Calibrated on:

Shaughnessy
07-Jan-2008