




Pile Dynamics, Inc.

Transducer C032

Strain ($\mu\epsilon$)

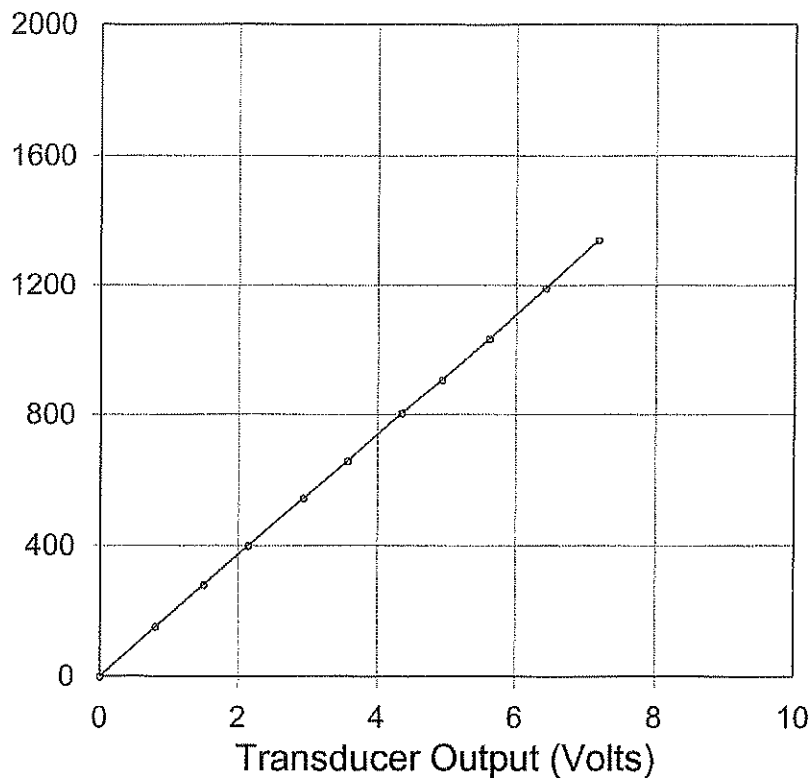

PDA Cal Factor (5.0 V)

92.5 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
152	0.79
279	1.49
399	2.14
542	2.93
658	3.57
803	4.34
905	4.92
1034	5.61
1191	6.42
1339	7.18

Shunt (60.4 K Ω)

2.5 V

General Factor

321.3 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:

Calibrated on:

04-Jan-2008