




# Pile Dynamics, Inc.

## Transducer C036

Strain ( $\mu\epsilon$ )

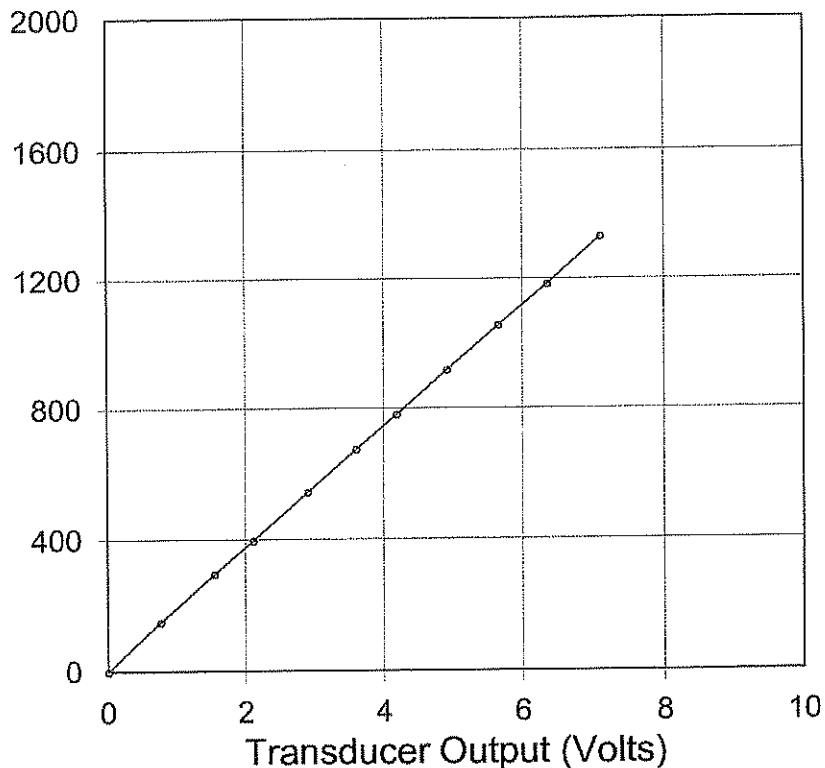

PDA Cal Factor (5.0 V)

93.1  $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
150	0.76
295	1.55
396	2.11
541	2.90
672	3.60
781	4.19
917	4.91
1055	5.65
1184	6.35
1331	7.10

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

323.1  $\mu\epsilon/mV/V$

Calibrated by:

Calibrated on:

28-Mar-2008

Traceable to N.I.S.T.