




Pile Dynamics, Inc.

Transducer C056

Strain ($\mu\epsilon$)

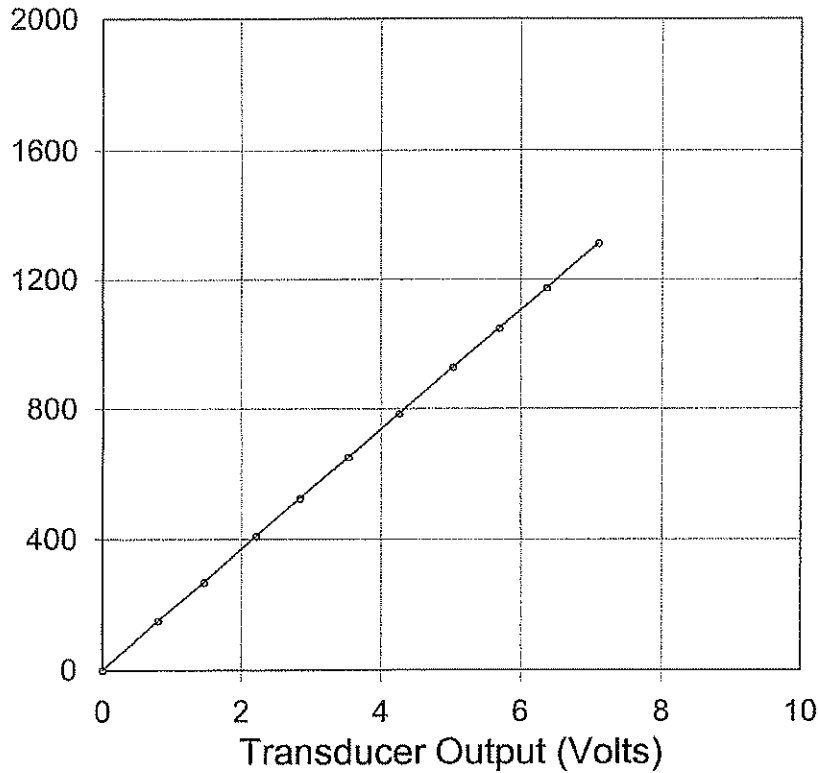

PDA Cal Factor (5.0 V)

92.3 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
152	0.79
269	1.45
409	2.21
524	2.84
651	3.53
784	4.25
929	5.02
1049	5.68
1175	6.36
1313	7.10

Shunt (60.4 K Ω)

2.5 V

General Factor

320.5 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Kathleen A. Hill

Calibrated on:

05-Dec-2007