




Pile Dynamics, Inc.

Transducer C059

Strain ($\mu\epsilon$)

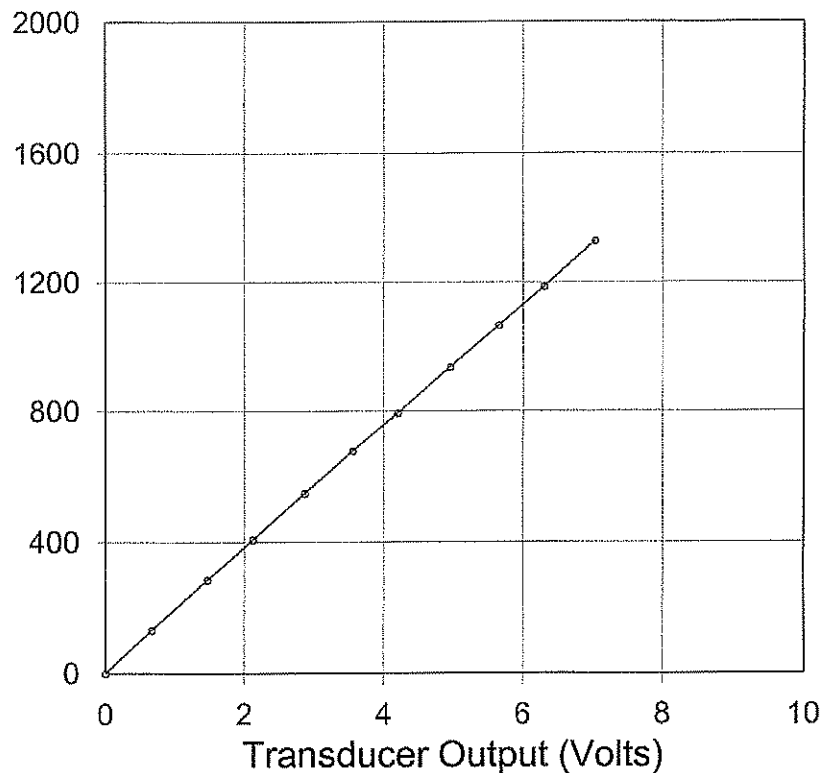

PDA Cal Factor (5.0 V)

94.0 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
133	0.66
284	1.46
407	2.12
546	2.87
676	3.55
793	4.20
937	4.95
1067	5.65
1188	6.30
1327	7.03

Shunt (60.4 K Ω)

2.5 V

General Factor

326.3 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:

Karla H. Miller

Calibrated on:

05-Dec-2007