




Pile Dynamics, Inc.

Transducer C061

Strain ($\mu\epsilon$)

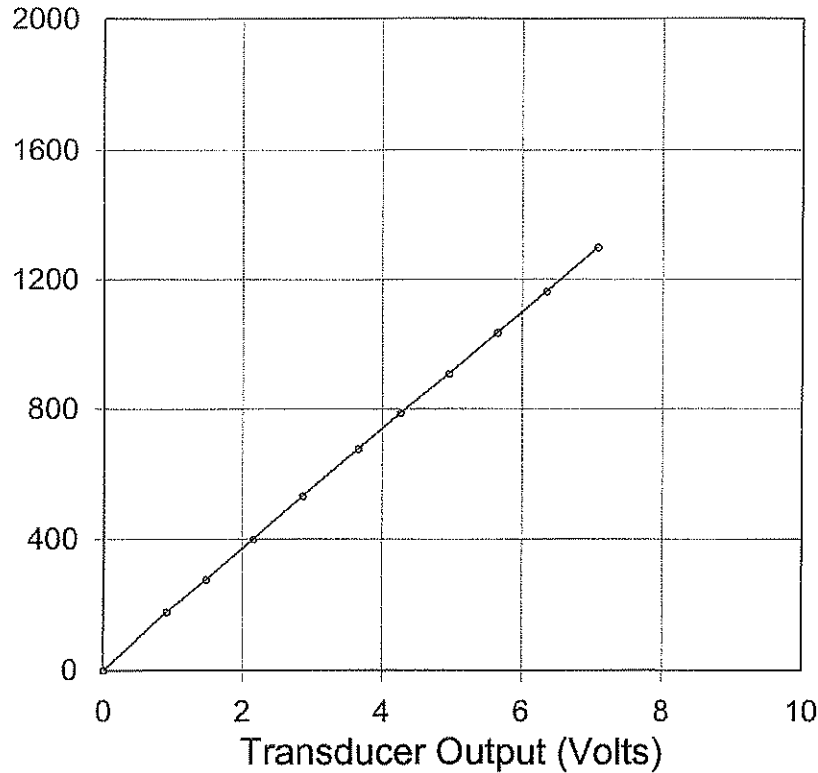

PDA Cal Factor (5.0 V)

91.2 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
179	0.91
278	1.47
400	2.15
531	2.86
676	3.65
787	4.26
908	4.95
1035	5.64
1164	6.34
1299	7.08

Shunt (60.4 K Ω)

2.5 V

General Factor

316.8 $\mu\epsilon$ /mV/V

Traceable to N.I.S.T.

Calibrated by:

Kathleen Miller

Calibrated on:

05-Dec-2007