




Pile Dynamics, Inc.

Transducer C080

Strain ($\mu\epsilon$)

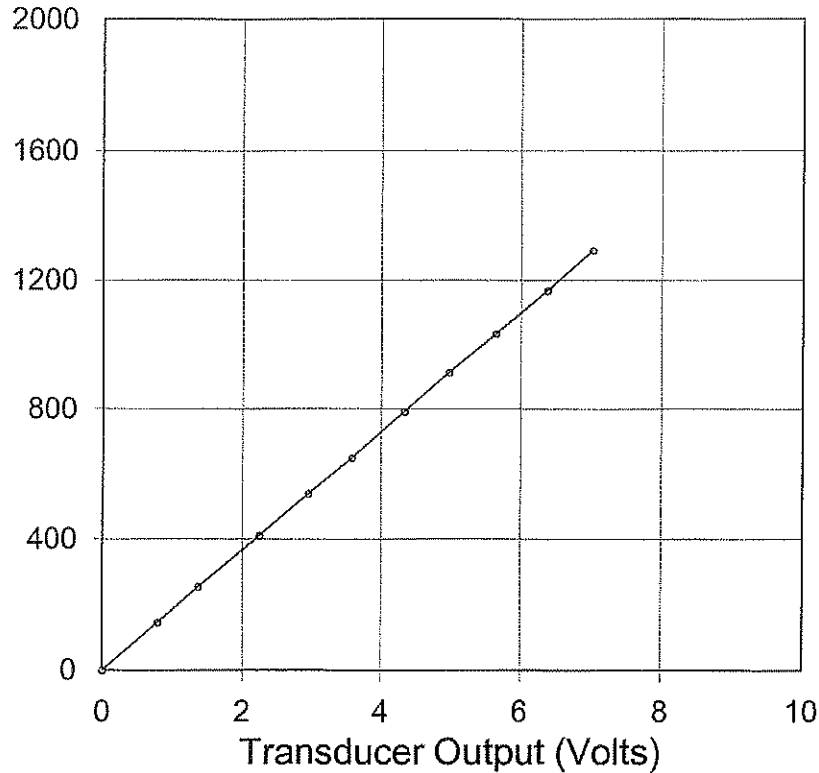

PDA Cal Factor (5.0 V)

91.7 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
145	0.78
254	1.36
410	2.24
537	2.95
648	3.57
791	4.33
911	4.97
1034	5.64
1168	6.37
1292	7.02

Shunt (60.4 K Ω)

2.5 V

General Factor

318.3 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

08-Jun-2009