




Pile Dynamics, Inc.

Transducer C081

Strain ($\mu\epsilon$)

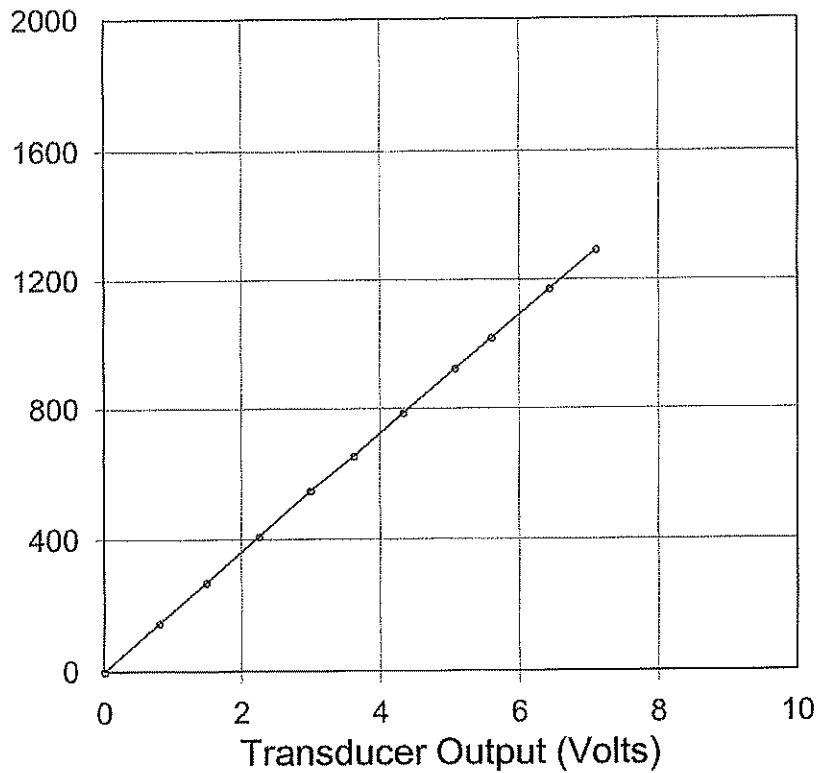

PDA Cal Factor (5.0 V)

91.0 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
148	0.79
270	1.48
408	2.25
547	3.00
653	3.62
784	4.32
923	5.08
1017	5.60
1172	6.43
1294	7.10

Shunt (60.4 K Ω)

2.5 V

General Factor

316.0 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:

Calibrated on:

07-Jan-2008