




Pile Dynamics, Inc.

Transducer C082

Strain ($\mu\epsilon$)

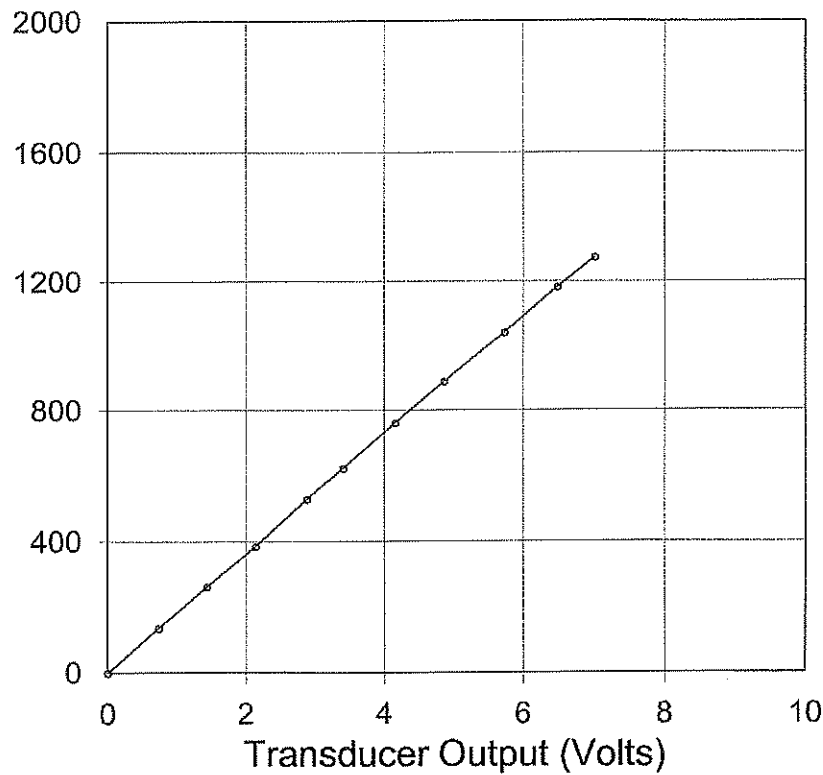

PDA Cal Factor (5.0 V)

91.0 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
138	0.73
263	1.43
385	2.14
528	2.88
621	3.40
759	4.15
888	4.86
1040	5.72
1183	6.48
1276	7.01

Shunt (60.4 K Ω)

2.5 V

General Factor

316.0 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by:

Calibrated on:

21-Sep-2009