




# Pile Dynamics, Inc.


## Transducer C084

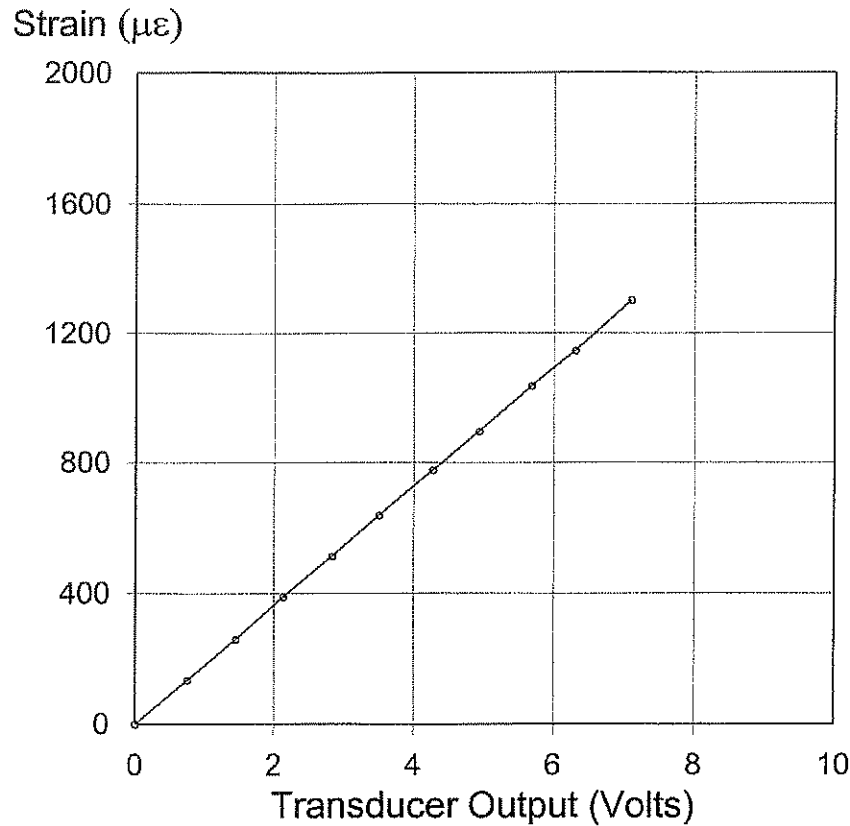

PDA Cal Factor (5.0 V) 91.4 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
136	0.74
261	1.44
388	2.13
512	2.83
637	3.50
775	4.26
895	4.92
1036	5.67
1147	6.30
1301	7.10

Shunt (60.4 K $\Omega$ ) 2.5 V  
 General Factor 317.4 $\mu\epsilon/mV/V$

Calibrated by:   
 Calibrated on: 04-Jan-2008

Traceable to N.I.S.T.