




Pile Dynamics, Inc.

Transducer C087

Strain ($\mu\epsilon$)

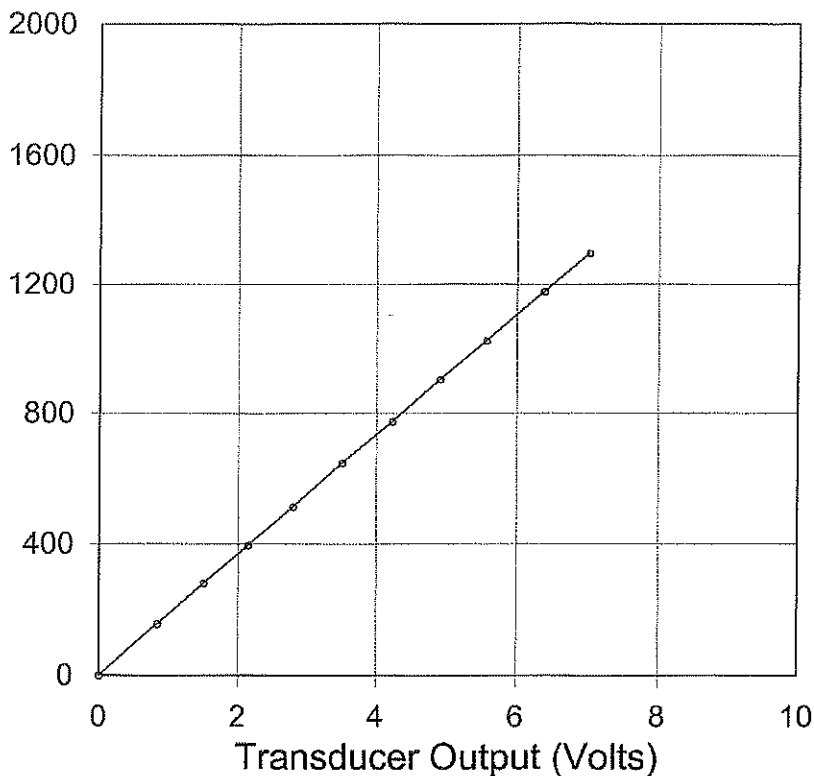

PDA Cal Factor (5.0 V)

92.2 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
158	0.83
281	1.50
395	2.14
513	2.79
645	3.50
773	4.21
903	4.90
1026	5.56
1179	6.37
1297	7.01

Shunt (60.4 K Ω)

2.5 V

General Factor

320.2 $\mu\epsilon/mV/V$

Calibrated by:

Calibrated on:

29-Jul-2008

Traceable to N.I.S.T.