




Pile Dynamics, Inc.

Transducer C109

Strain ($\mu\epsilon$)

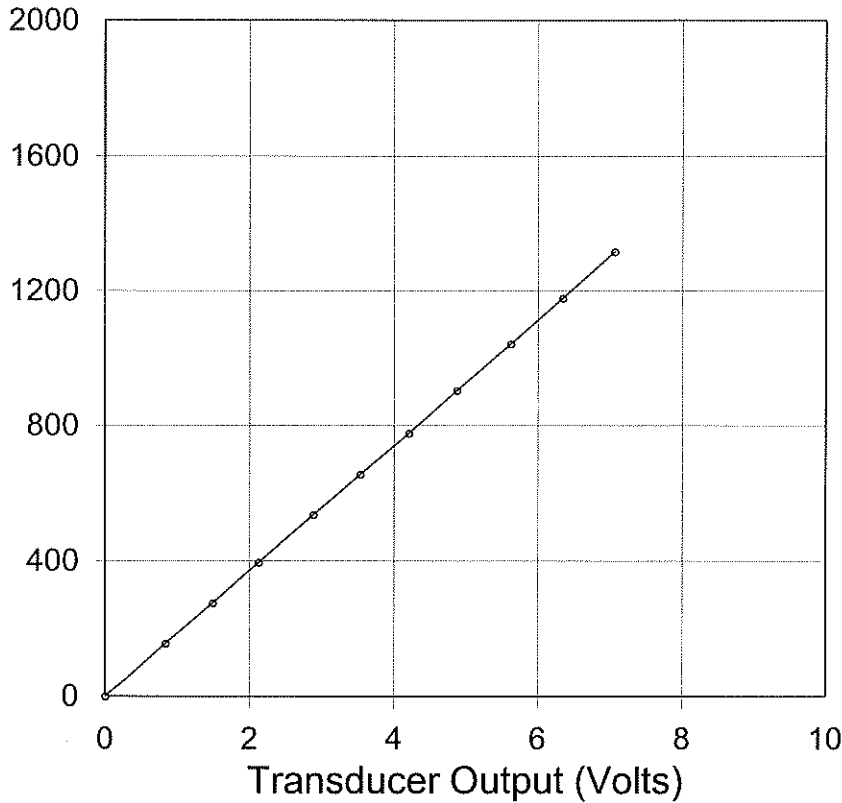

PDA Cal Factor (5.0 V)

92.9 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
158	0.82
276	1.48
394	2.12
536	2.88
654	3.53
777	4.20
904	4.87
1041	5.62
1178	6.34
1317	7.06

Shunt (60.4 K Ω)

2.5 V

General Factor

322.5 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

29-May-2008