




Pile Dynamics, Inc.

Transducer C112

Strain ($\mu\epsilon$)

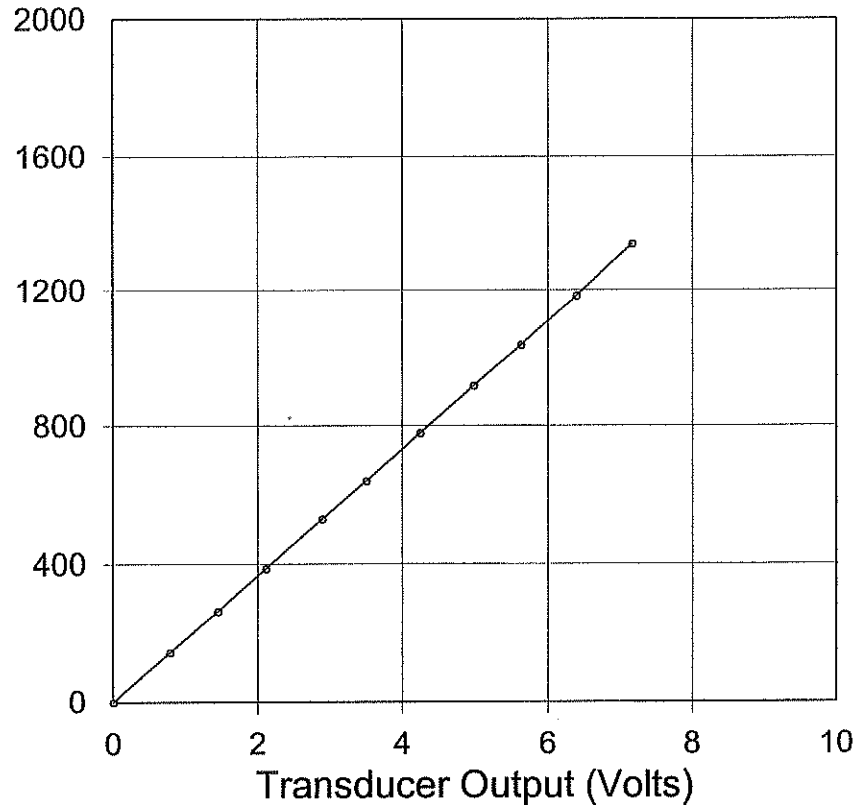

PDA Cal Factor (5.0 V)

92.7 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
148	0.78
296	1.56
444	2.34
592	3.12
740	3.90
888	4.68
1036	5.46
1184	6.24
1332	7.02

Shunt (60.4 K Ω)

2.5 V

General Factor

321.9 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

Handwritten signature
22-Jan-2008