




Pile Dynamics, Inc.

Transducer C113

Strain ($\mu\epsilon$)

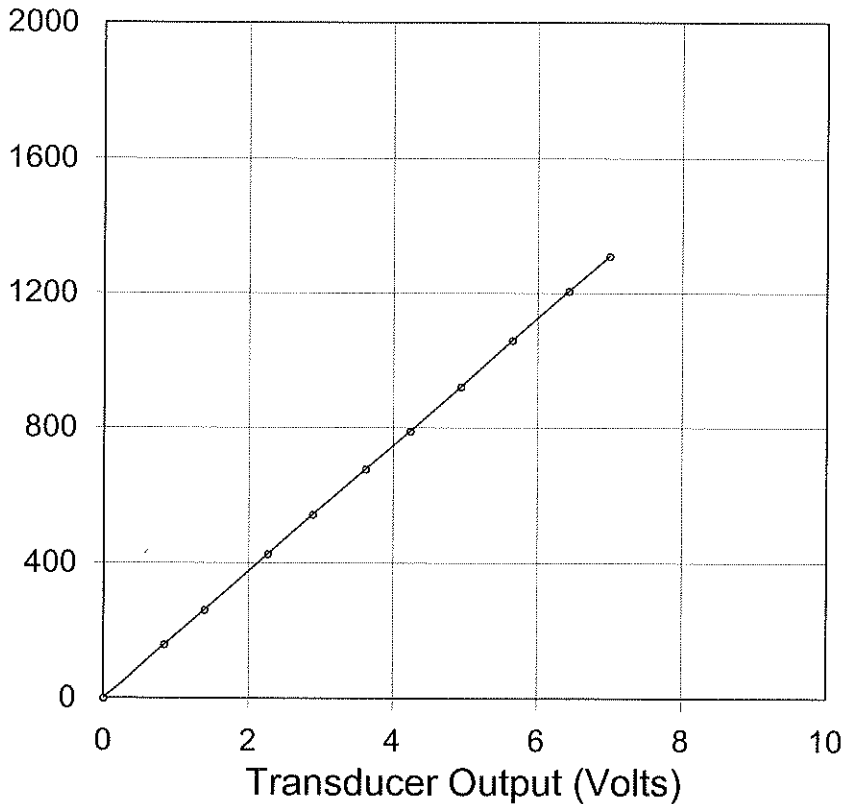

PDA Cal Factor (5.0 V)

93.6 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
159	0.82
261	1.38
425	2.26
542	2.88
676	3.61
789	4.23
921	4.93
1059	5.64
1207	6.42
1311	6.99

Shunt (60.4 K Ω)

2.5 V

General Factor

324.9 $\mu\epsilon$ /mV/V

Calibrated by:

Calibrated on:

10-Jun-2008

Traceable to N.I.S.T.