




Pile Dynamics, Inc.

Transducer C114

Strain ($\mu\epsilon$)

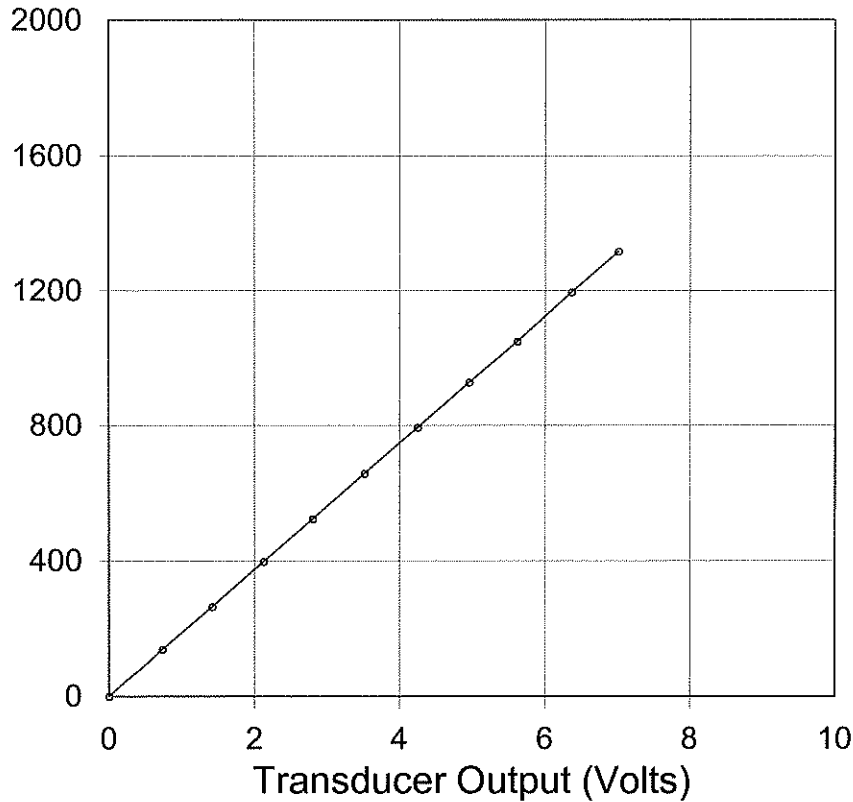

PDA Cal Factor (5.0 V)

93.7 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
139	0.71
266	1.41
398	2.12
522	2.80
656	3.51
793	4.24
927	4.95
1049	5.61
1195	6.36
1318	7.01

Shunt (60.4 K Ω)

2.5 V

General Factor

325.3 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

21-Jun-2010