




# Pile Dynamics, Inc.

## Transducer C118

Strain ( $\mu\epsilon$ )

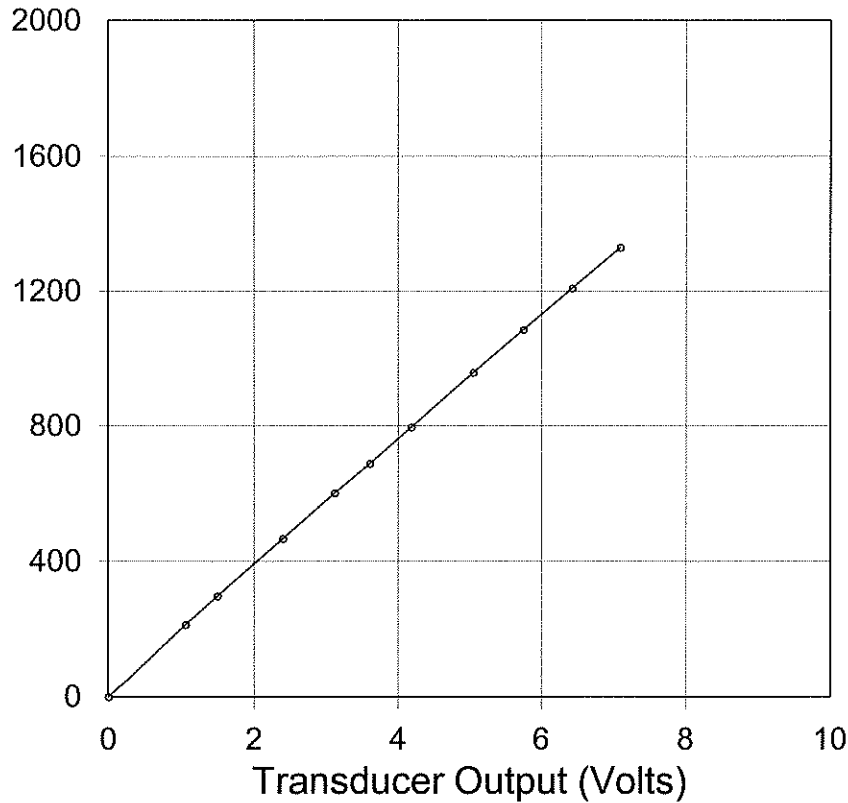

PDA Cal Factor (5.0 V)

93.3 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
213	1.05
297	1.49
466	2.40
600	3.11
688	3.60
795	4.18
957	5.04
1085	5.74
1210	6.43
1330	7.09

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

324.0 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:

Calibrated on:

03-Apr-2009