




Pile Dynamics, Inc.

Transducer C128

Strain ($\mu\epsilon$)

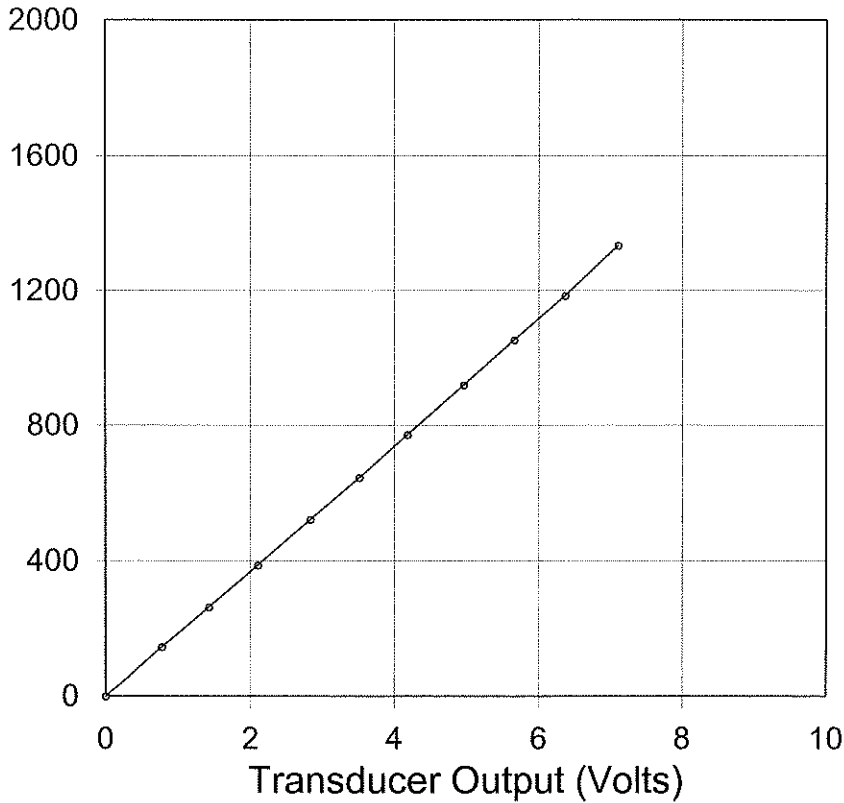

PDA Cal Factor (5.0 V)

93.5 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
146	0.77
262	1.42
387	2.10
519	2.83
645	3.51
772	4.18
918	4.95
1053	5.65
1185	6.36
1334	7.10

Shunt (60.4 K Ω)

2.5 V

General Factor

324.6 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:

Calibrated on:

29-May-2008