




Pile Dynamics, Inc.

Transducer E729

Strain ($\mu\epsilon$)

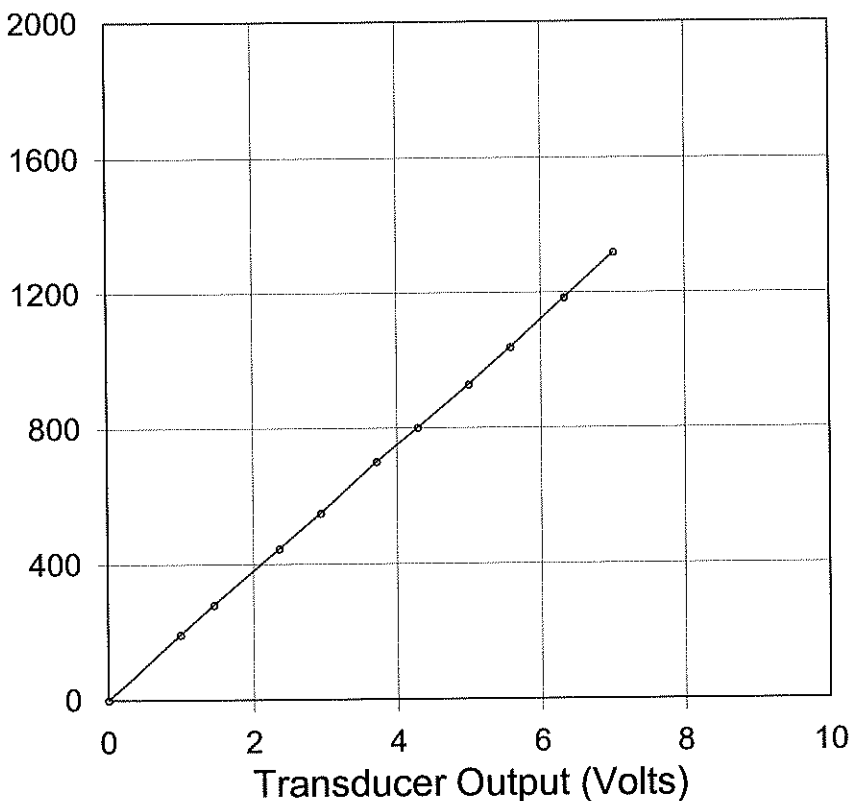

PDA Cal Factor (5.0 V)

93.3 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
194	0.98
281	1.45
445	2.35
550	2.93
700	3.71
801	4.28
928	4.99
1038	5.57
1186	6.32
1318	7.01

Shunt (60.4 K Ω)

2.5 V

General Factor

323.8 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

16-Apr-2010