




Pile Dynamics, Inc.

Transducer E730

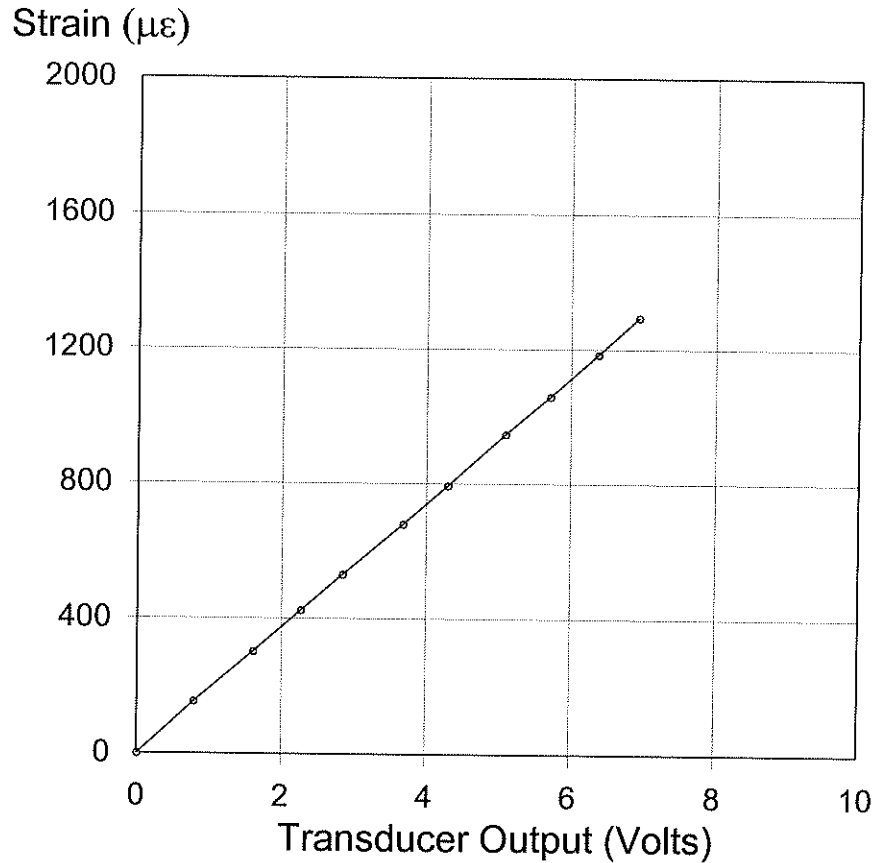


PDA Cal Factor (5.0 V) 92.7 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
154	0.79
302	1.60
424	2.26
529	2.84
678	3.67
794	4.30
946	5.09
1059	5.71
1184	6.37
1295	6.93

Shunt (60.4 K Ω) 2.5 V
 General Factor 322.0 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by: 
 Calibrated on: 08-Dec-2009