




Pile Dynamics, Inc.

Transducer E732

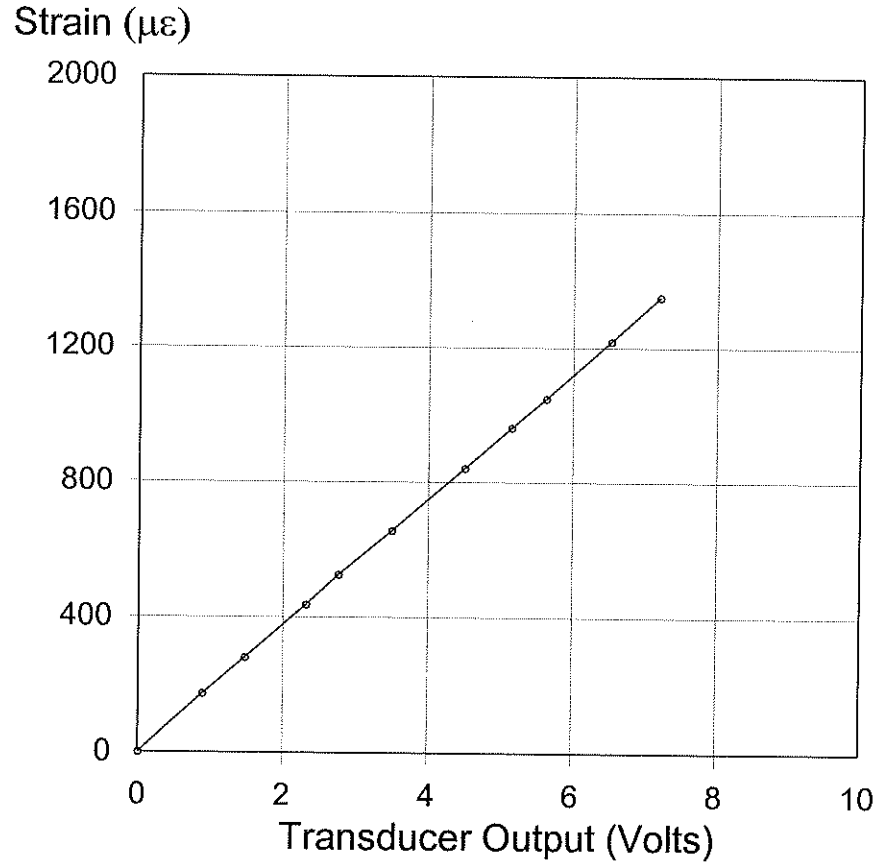

PDA Cal Factor (5.0 V) 93.2 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
175	0.88
281	1.47
436	2.31
524	2.76
656	3.48
842	4.49
962	5.14
1048	5.62
1220	6.52
1352	7.21

Shunt (60.4 K Ω) 2.5 V
 General Factor 323.6 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by: *[Signature]*
 Calibrated on: 08-Dec-2009