




Pile Dynamics, Inc.

Pile Dynamics, Inc. Transducer E742

Strain ($\mu\epsilon$)

PDA Cal Factor (5.0 V)

94.3 $\mu\epsilon/V$

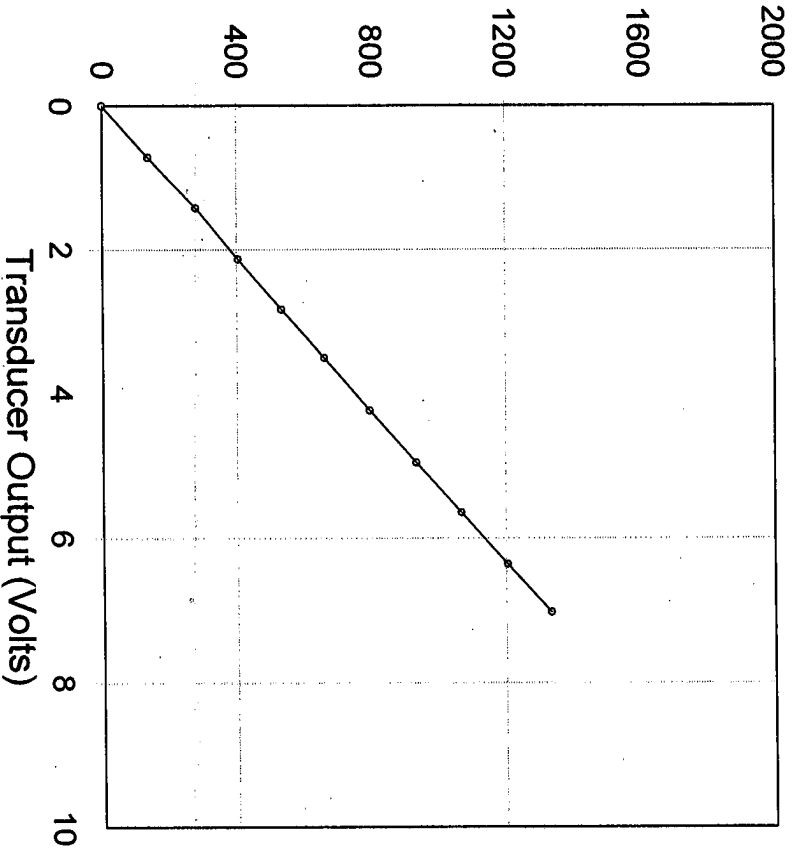

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
138	0.71
277	1.42
403	2.13
531	2.83
657	3.51
794	4.23
931	4.95
1067	5.64
1204	6.36
1334	7.03

Shunt (60.4 K Ω)

2.5 V

General Factor

327.5 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by: MMO

Strain Transducer Calibrator System 2011 Version 1.5

Calibrated on: 15-Sep-2014

Smart Sensor?

Yes

No Smart Chip

Programmed by: MS

Date: 9-15-14

CRC value 78A5