




# Pile Dynamics, Inc.

## Transducer E746

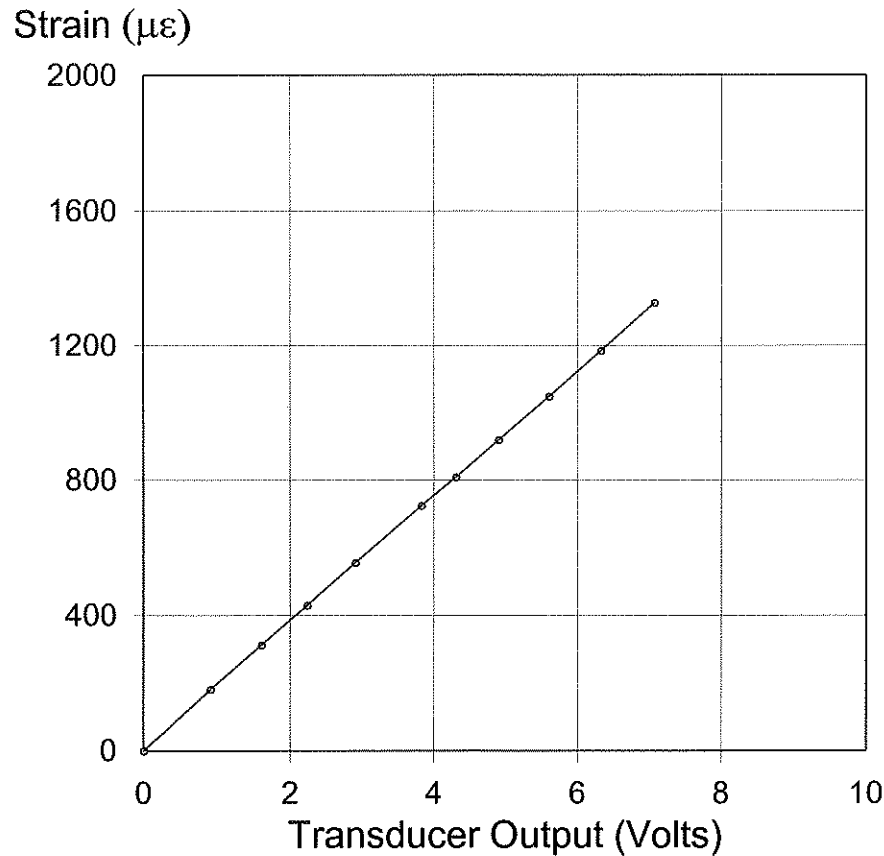

PDA Cal Factor (5.0 V) 93.0 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
182	0.90
312	1.60
429	2.23
554	2.90
725	3.83
808	4.30
919	4.90
1048	5.60
1184	6.32
1328	7.07

Shunt (60.4 K $\Omega$ ) 2.5 V  
 General Factor 323.0 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by: *Stueck*  
 Calibrated on: 30-Jul-2010