




Pile Dynamics, Inc.

Transducer E747

Strain ($\mu\epsilon$)

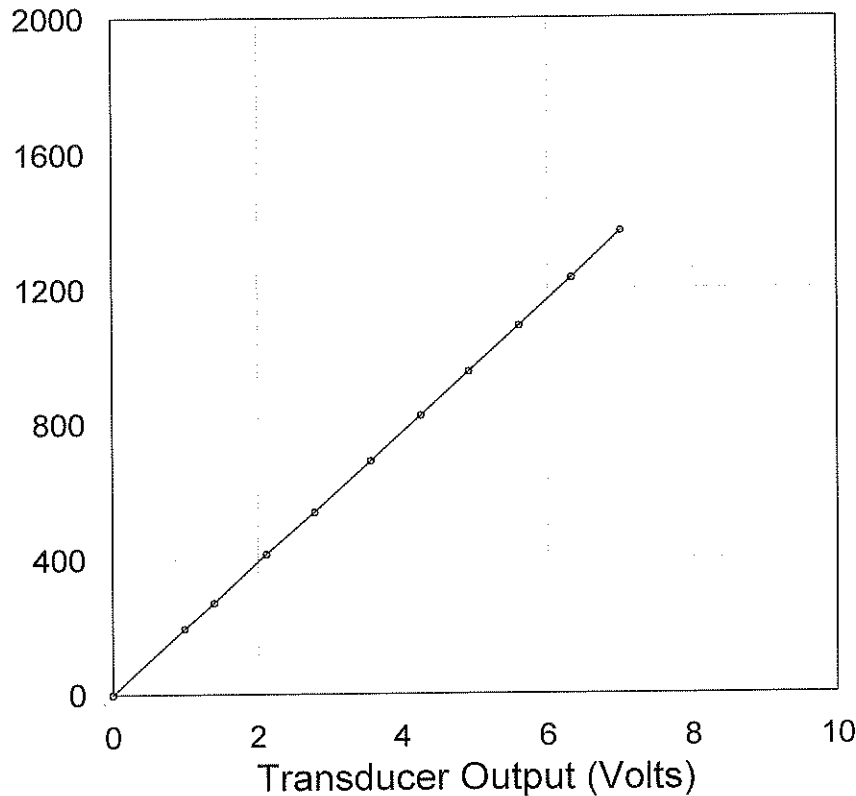

PDA Cal Factor (5.0 V)

97.3 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
195	0.98
272	1.39
414	2.12
538	2.79
689	3.57
824	4.26
954	4.92
1090	5.61
1233	6.33
1370	7.01

Shunt (60.4 K Ω)

2.5 V

General Factor

338.0 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

29-Feb-2012