




# Pile Dynamics, Inc.

## Transducer E751

Strain ( $\mu\epsilon$ )

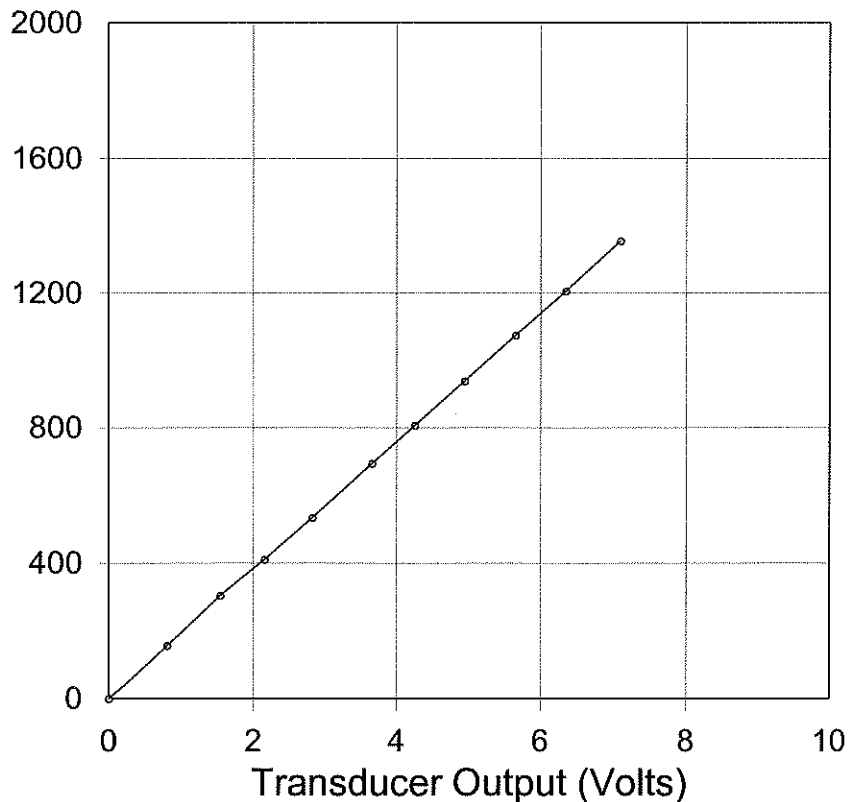

PDA Cal Factor (5.0 V)

94.9 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
157	0.79
304	1.53
411	2.15
534	2.82
694	3.65
806	4.25
938	4.94
1075	5.65
1207	6.34
1356	7.09

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

329.6 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

18-May-2010