




Pile Dynamics, Inc.

Transducer E752

Strain ($\mu\epsilon$)

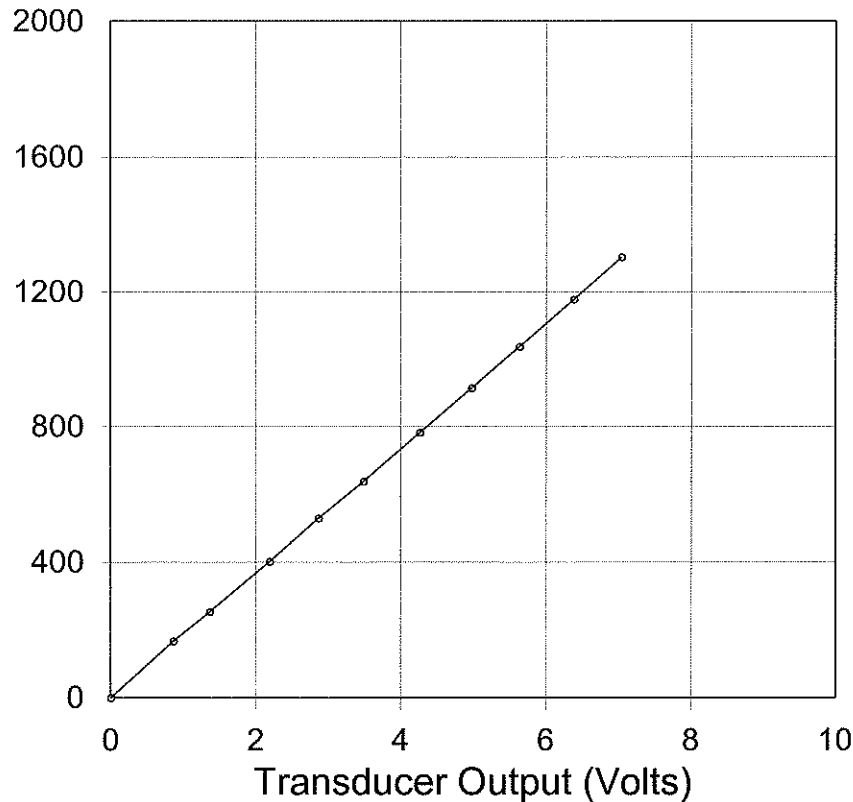

PDA Cal Factor (5.0 V)

92.0 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
168	0.85
254	1.35
402	2.19
529	2.87
638	3.49
783	4.26
915	4.97
1037	5.63
1178	6.38
1305	7.04

Shunt (60.4 K Ω)

2.5 V

General Factor

319.4 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by:

Calibrated on:

15-Dec-2009