




# Pile Dynamics, Inc.

## Transducer E761

Strain ( $\mu\epsilon$ )

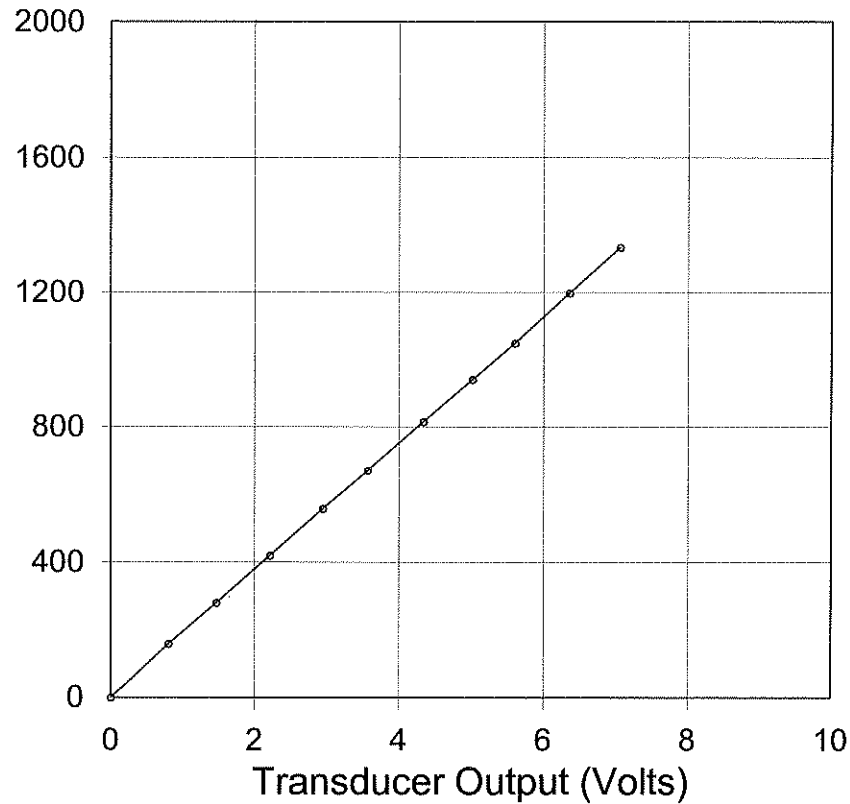

PDA Cal Factor (5.0 V)

93.8 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
160	0.79
281	1.46
420	2.21
557	2.94
671	3.56
815	4.33
940	5.01
1050	5.60
1198	6.35
1335	7.05

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

325.8 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

18-May-2010