




# Pile Dynamics, Inc.

## Transducer E769

Strain ( $\mu\epsilon$ )

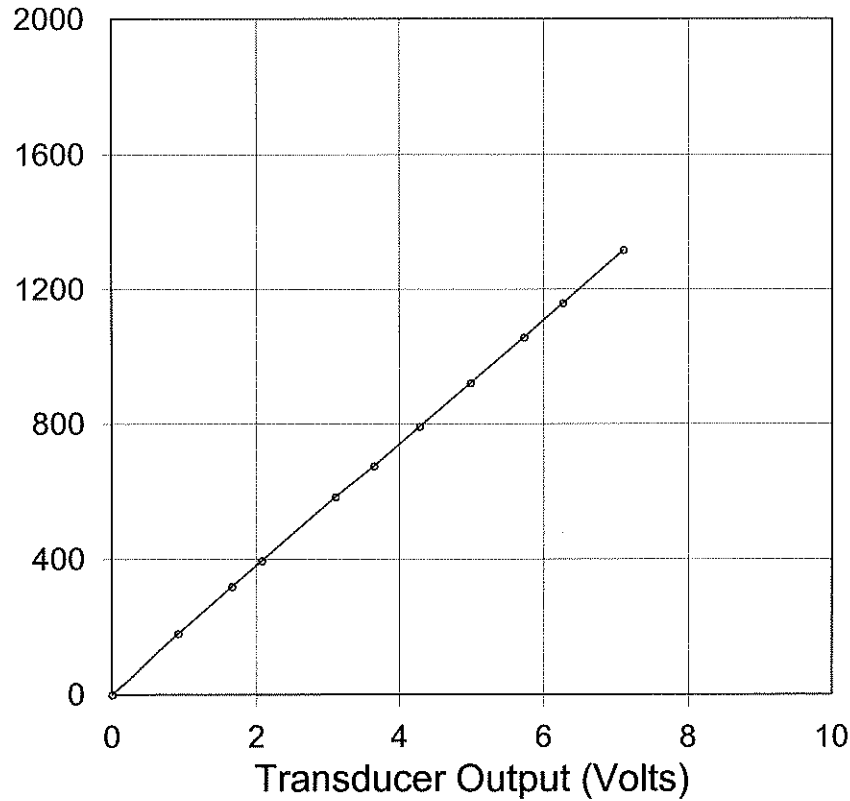

PDA Cal Factor (5.0 V)

91.7 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
180	0.90
319	1.66
395	2.07
584	3.11
674	3.64
792	4.28
921	4.98
1057	5.72
1159	6.26
1316	7.10

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

318.5 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

30-Jul-2010