




Pile Dynamics, Inc.

# Pile Dynamics, Inc.

## Transducer

## E788

Strain ( $\mu\epsilon$ )

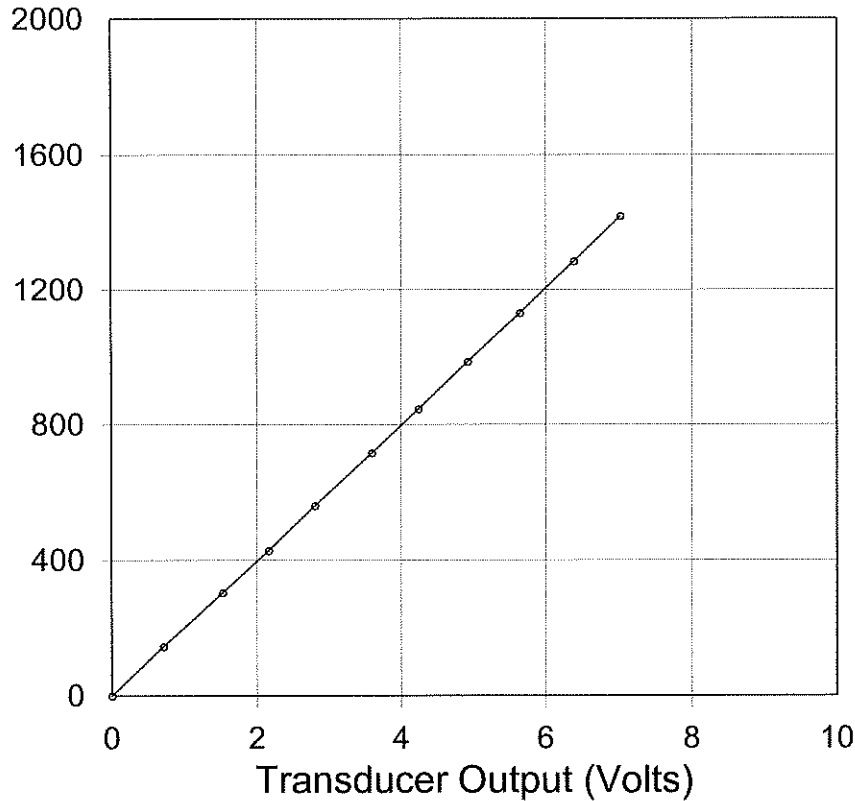

PDA Cal Factor (5.0 V)

100.8 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
145	0.71
304	1.52
428	2.16
560	2.80
716	3.59
846	4.24
986	4.92
1131	5.64
1285	6.38
1419	7.02

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

350.1 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

10-Dec-2009