




Pile Dynamics, Inc.

# Pile Dynamics, Inc.

## Transducer

## E993

Strain ( $\mu\epsilon$ )

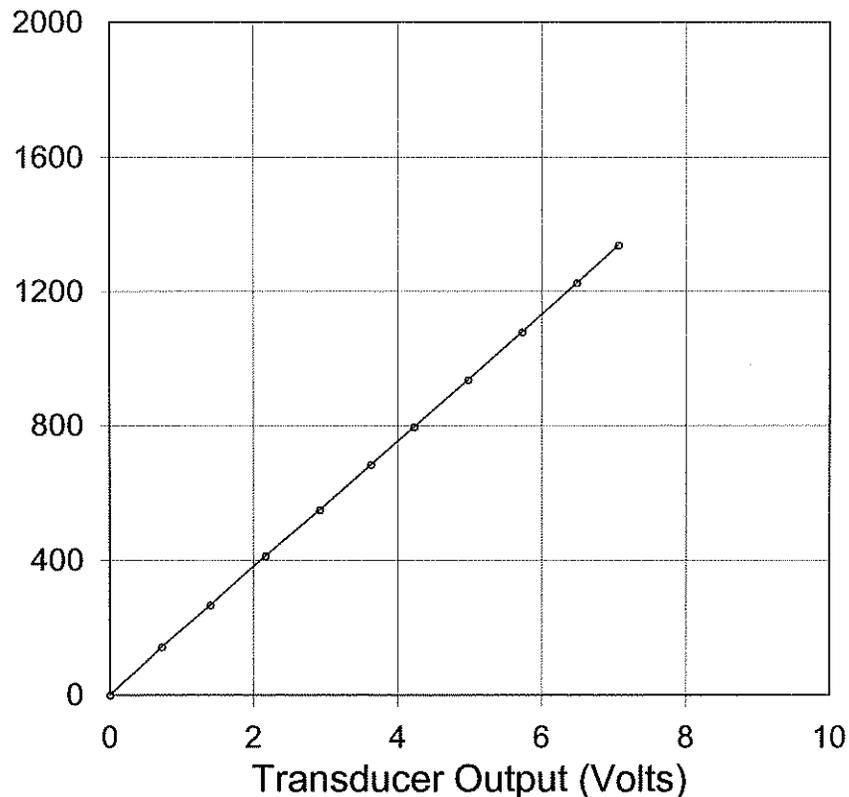

PDA Cal Factor (5.0 V)

94.1  $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
144	0.71
267	1.39
413	2.16
549	2.91
684	3.62
796	4.22
937	4.98
1078	5.72
1226	6.49
1338	7.06

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

326.8  $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

01-Sep-2010