




Pile Dynamics, Inc.

Transducer E995

Strain ($\mu\epsilon$)

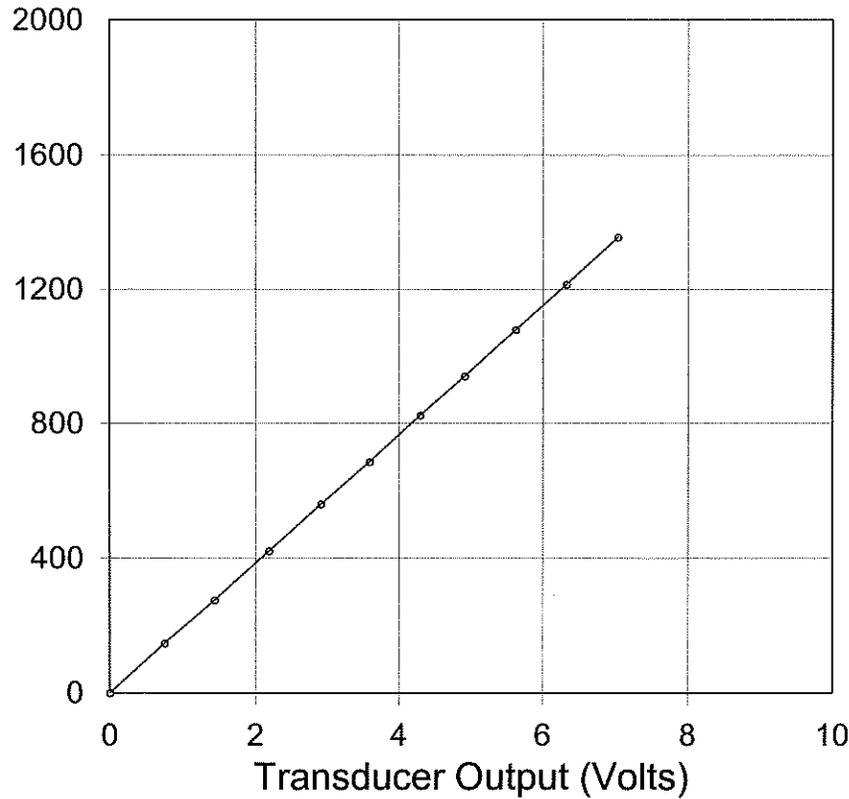

PDA Cal Factor (5.0 V)

96.0 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
147	0.73
276	1.43
421	2.18
559	2.90
686	3.58
824	4.29
941	4.91
1079	5.62
1215	6.32
1356	7.03

Shunt (60.4 K Ω)

2.5 V

General Factor

333.3 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

02-Mar-2010