




# Pile Dynamics, Inc.

## Transducer G501

Strain ( $\mu\epsilon$ )

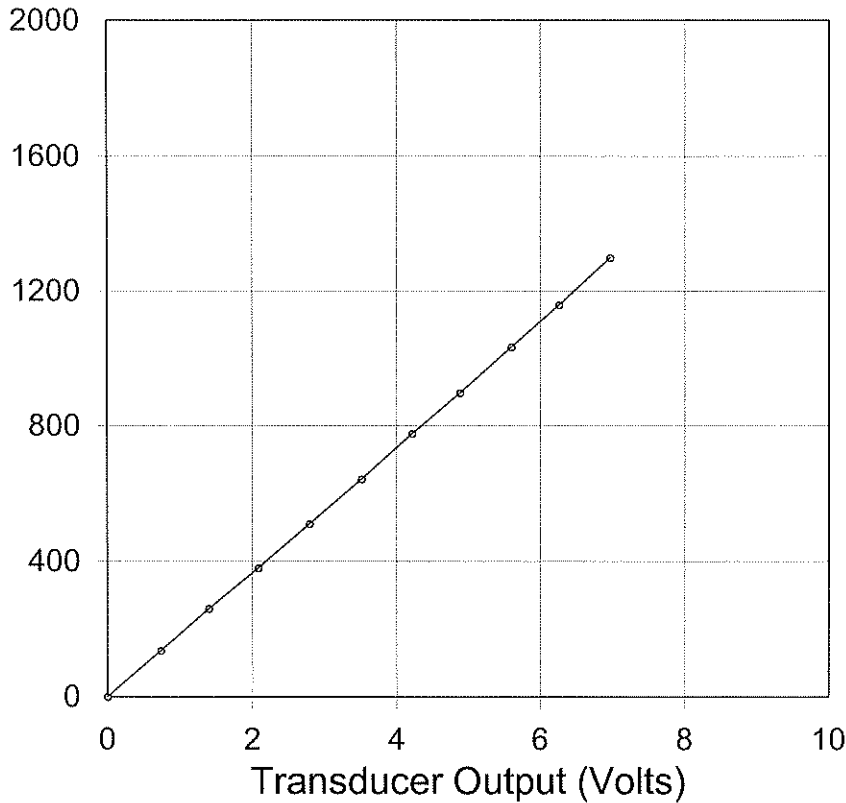

PDA Cal Factor (5.0 V)

92.7  $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
137	0.73
260	1.40
381	2.08
511	2.79
643	3.51
775	4.21
898	4.88
1033	5.59
1158	6.25
1299	6.97

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

321.9  $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

14-Apr-2011