




Pile Dynamics, Inc.

Transducer G504

Strain ($\mu\epsilon$)

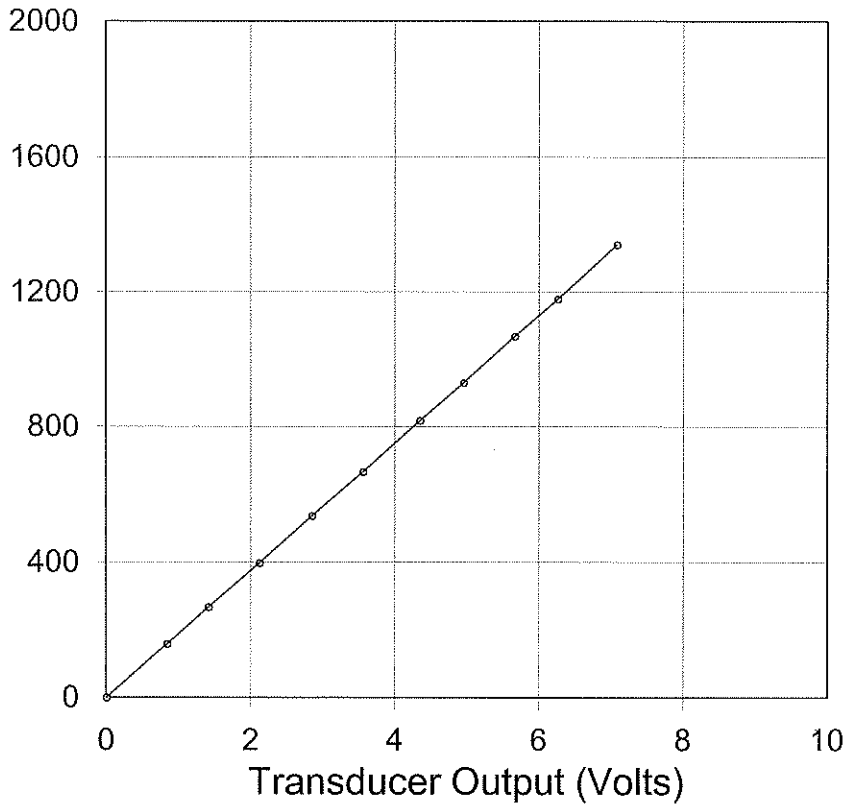

PDA Cal Factor (5.0 V)

94.3 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
160	0.83
267	1.41
397	2.11
536	2.85
666	3.56
816	4.34
930	4.95
1069	5.66
1179	6.26
1340	7.08

Shunt (60.4 K Ω)

2.5 V

General Factor

327.6 $\mu\epsilon$ /mV/V

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by:

Calibrated on:

15-Apr-2011