




Pile Dynamics, Inc.

Transducer G512

Strain ($\mu\epsilon$)

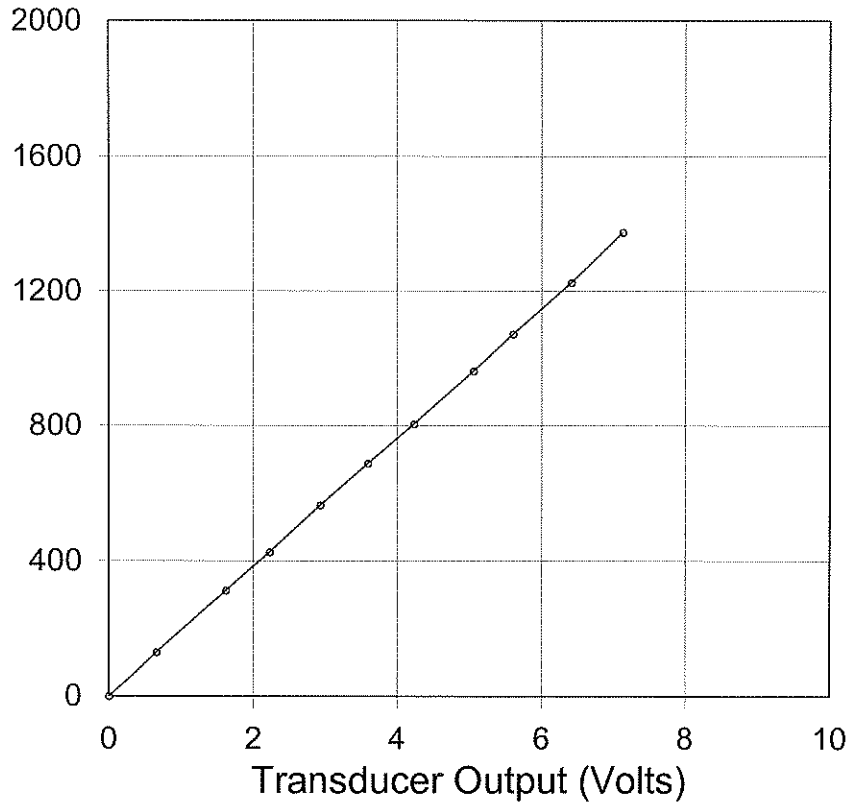

PDA Cal Factor (5.0 V)

95.6 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
130	0.65
312	1.61
426	2.22
563	2.93
686	3.59
805	4.23
962	5.05
1072	5.60
1227	6.42
1375	7.13

Shunt (60.4 K Ω)

2.5 V

General Factor

332.1 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

20-Apr-2011