




Pile Dynamics, Inc.

Transducer G513

Strain ($\mu\epsilon$)

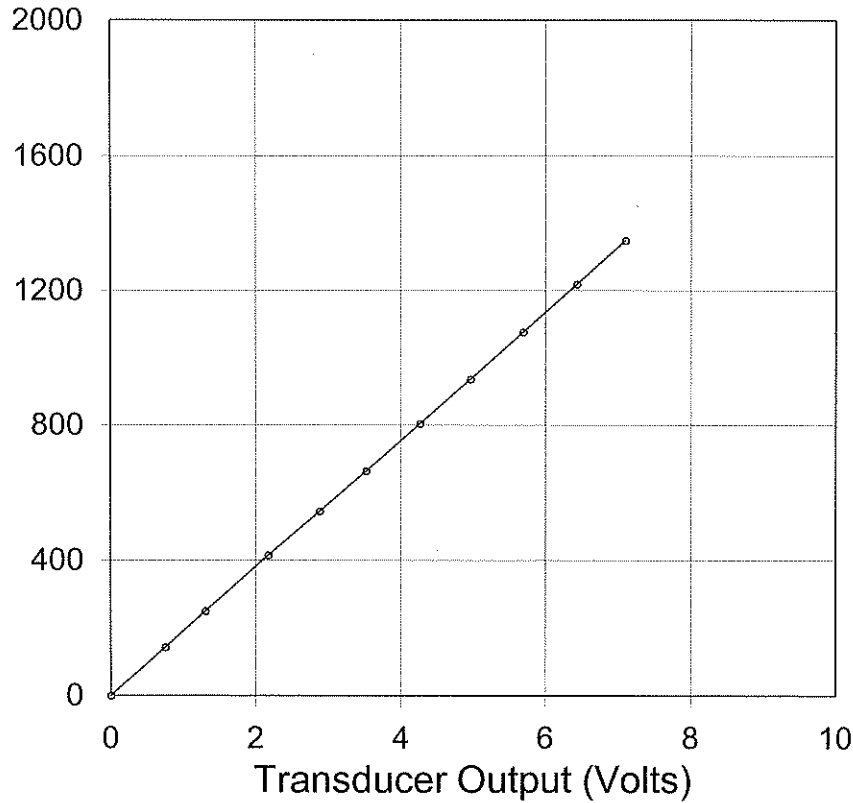

PDA Cal Factor (5.0 V)

94.5 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
144	0.74
251	1.30
415	2.17
545	2.88
663	3.52
805	4.26
937	4.96
1076	5.69
1220	6.44
1350	7.10

Shunt (60.4 K Ω)

2.5 V

General Factor

328.3 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by:

Calibrated on:

20-Apr-2011