




Pile Dynamics, Inc.

Transducer G516

Strain ($\mu\epsilon$)

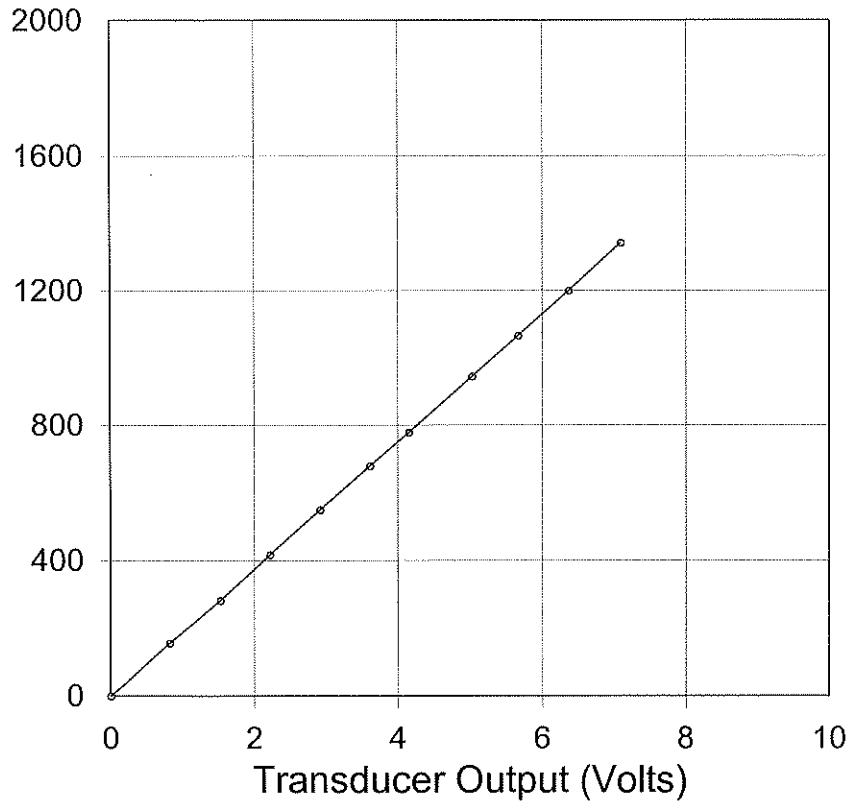

PDA Cal Factor (5.0 V)

94.4 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
157	0.81
283	1.52
417	2.22
549	2.92
679	3.61
778	4.15
944	5.02
1067	5.67
1199	6.36
1343	7.09

Shunt (60.4 K Ω)
General Factor

2.5 V
327.7 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by:
Calibrated on:

20-Apr-2011