




Pile Dynamics, Inc.

Transducer G540

Strain ($\mu\epsilon$)

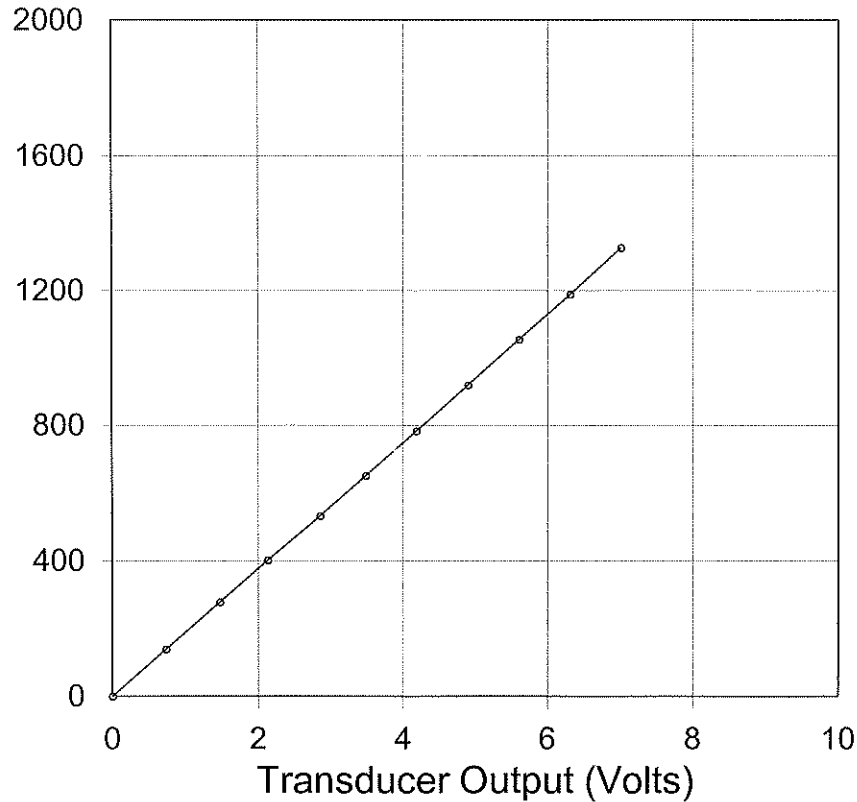

PDA Cal Factor (5.0 V)

94.4 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
139	0.73
278	1.47
401	2.13
531	2.85
650	3.48
782	4.18
919	4.90
1056	5.60
1190	6.31
1327	7.00

Shunt (60.4 K Ω)

2.5 V

General Factor

327.8 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

18-Apr-2011