


Pile Dynamics, Inc.

Transducer G541

Strain ($\mu\epsilon$)

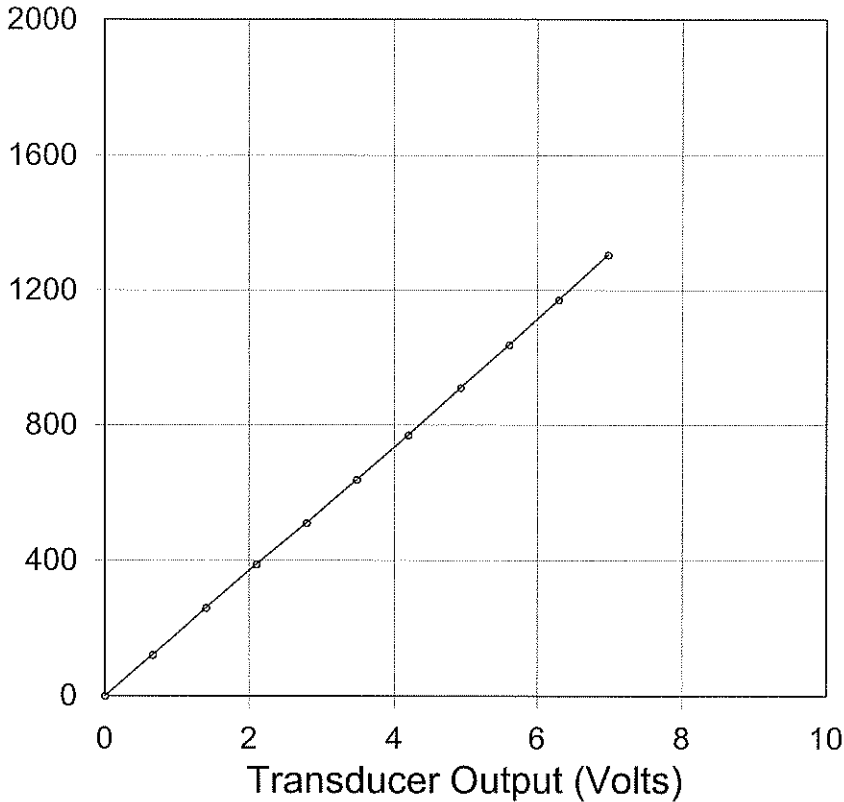

PDA Cal Factor (5.0 V)

93.2 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
123	0.66
260	1.40
388	2.10
511	2.79
638	3.48
771	4.19
910	4.92
1037	5.60
1172	6.29
1306	6.98

Shunt (60.4 K Ω)

2.5 V

General Factor

323.6 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

14-Apr-2011