




Pile Dynamics, Inc.

Transducer G855

Strain ($\mu\epsilon$)

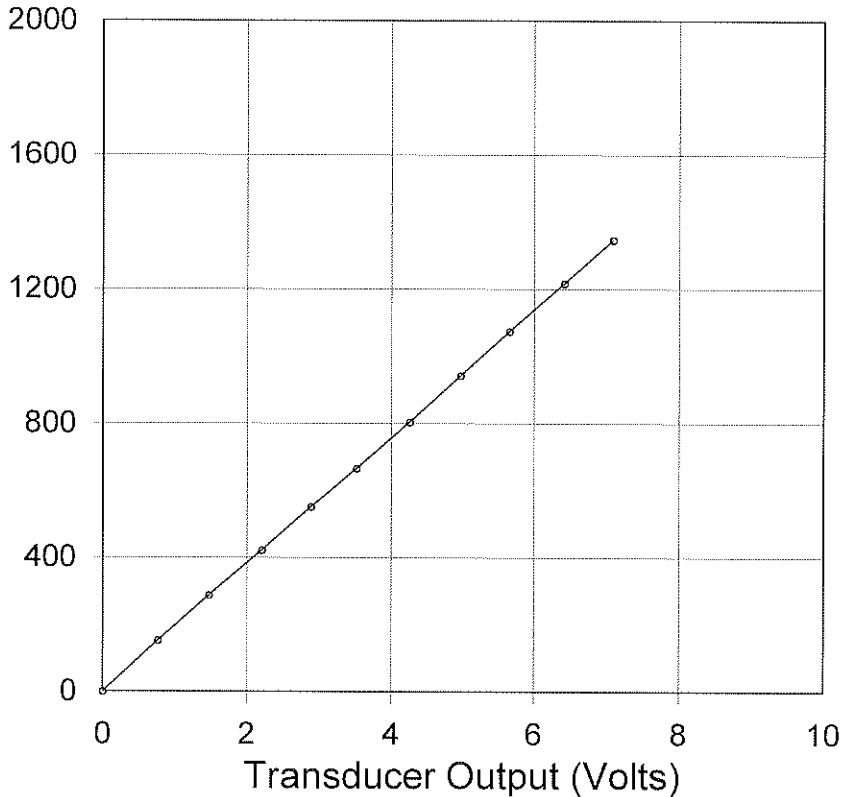

PDA Cal Factor (5.0 V)

94.5 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
152	0.76
288	1.47
421	2.20
550	2.88
665	3.51
805	4.25
943	4.97
1074	5.65
1217	6.41
1348	7.09

Shunt (60.4 K Ω)

2.5 V

General Factor

328.2 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by:

Calibrated on:

18-Oct-2011