




# Pile Dynamics, Inc.

## Transducer G864

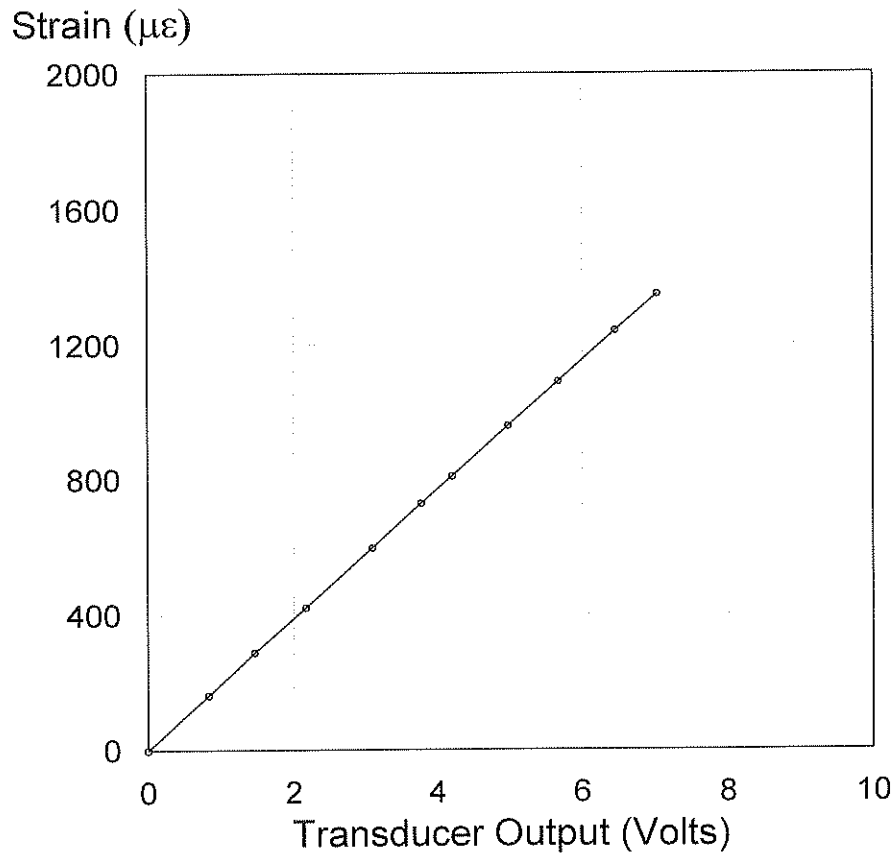


PDA Cal Factor (5.0 V) 95.7µε/V

Applied Strain (µε)	Transducer Output (Volts)
0	0.00
164	0.83
289	1.46
422	2.17
597	3.10
728	3.77
808	4.21
958	4.98
1089	5.67
1241	6.45
1350	7.03

Shunt (60.4 KΩ) 2.5 V  
 General Factor 332.5µε/mV/V

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2011 Version 1.5

Calibrated by:   
 Calibrated on: 06-Mar-2012