


Pile Dynamics, Inc.

Pile Dynamics, Inc.

Transducer G905

Strain ($\mu\epsilon$)

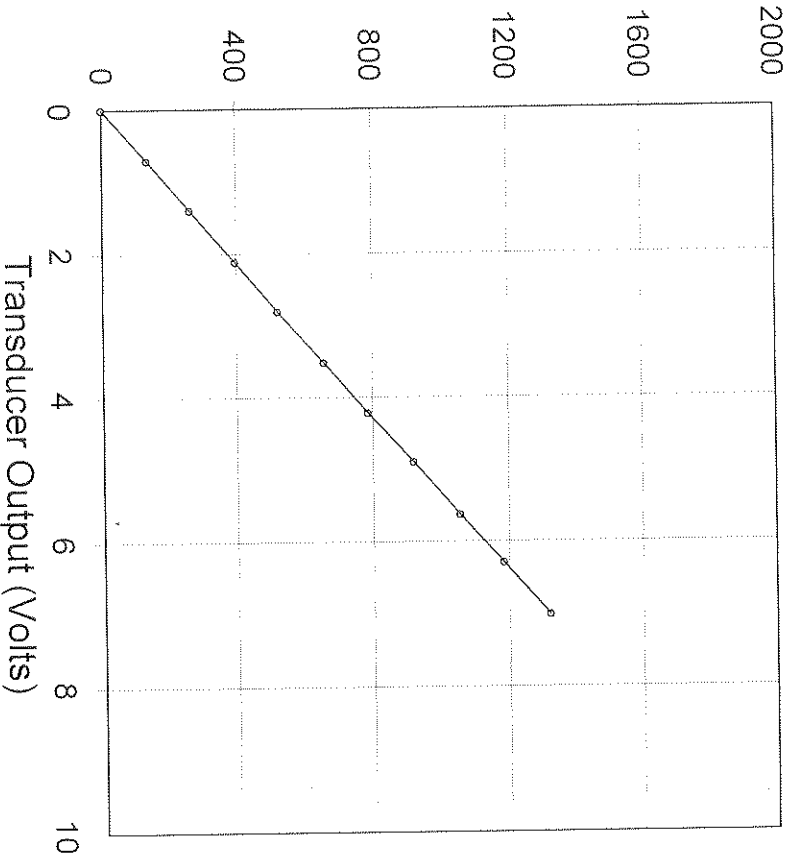

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

PDA Cal Factor (5.0 V)

94.1 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
136	0.70
262	1.39
398	2.11
522	2.79
658	3.51
787	4.21
920	4.89
1058	5.62
1185	6.29
1323	7.00

Shunt (60.4 K Ω)

2.5 V

General Factor

326.7 $\mu\epsilon/mV/V$

Calibrated by:

Kathie Hester

Calibrated on:

27-Sep-2011

Smart Sensor?

Yes

No Smart Chip Programmed by:

KH

on:

9/27/11

CRC value

9D3F