


# Pile Dynamics, Inc.

## Transducer H348

Strain ( $\mu\epsilon$ )

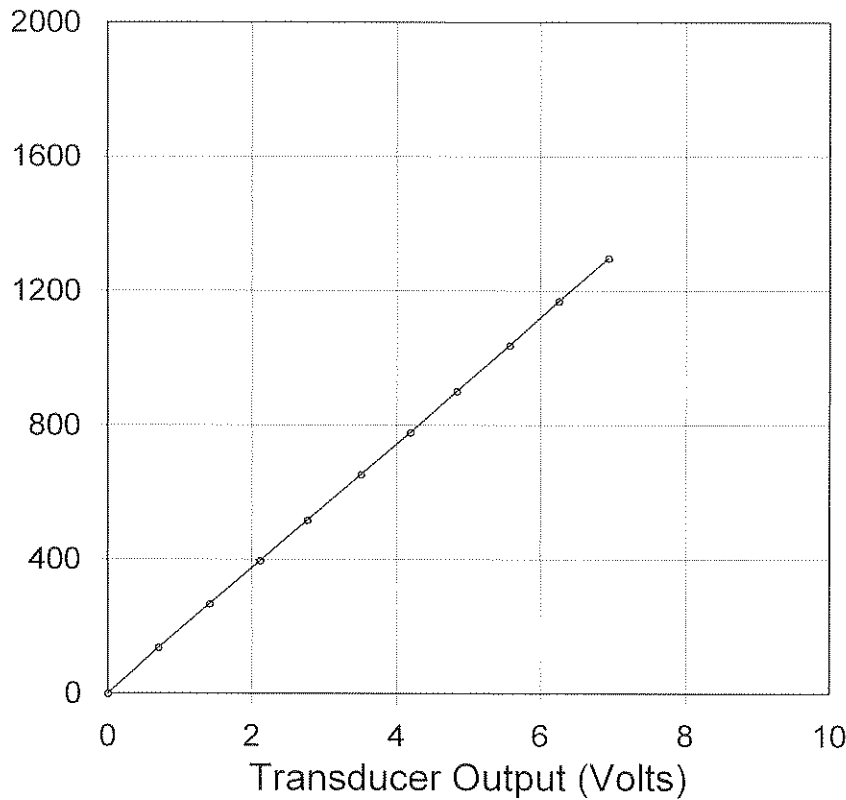

PDA Cal Factor (5.0 V)

93.3 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
136	0.70
268	1.41
395	2.11
516	2.76
652	3.50
779	4.19
901	4.84
1039	5.57
1170	6.25
1298	6.93

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

323.8 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2011 Version 1.5

Calibrated by:

*Kaitlin Arlt*

Calibrated on:

05-Dec-2011

Smart Sensor?  Yes  No Smart Chip

Programmed by: RY on: 12/5/11 CRC value 4918