




Pile Dynamics, Inc.

Transducer H351

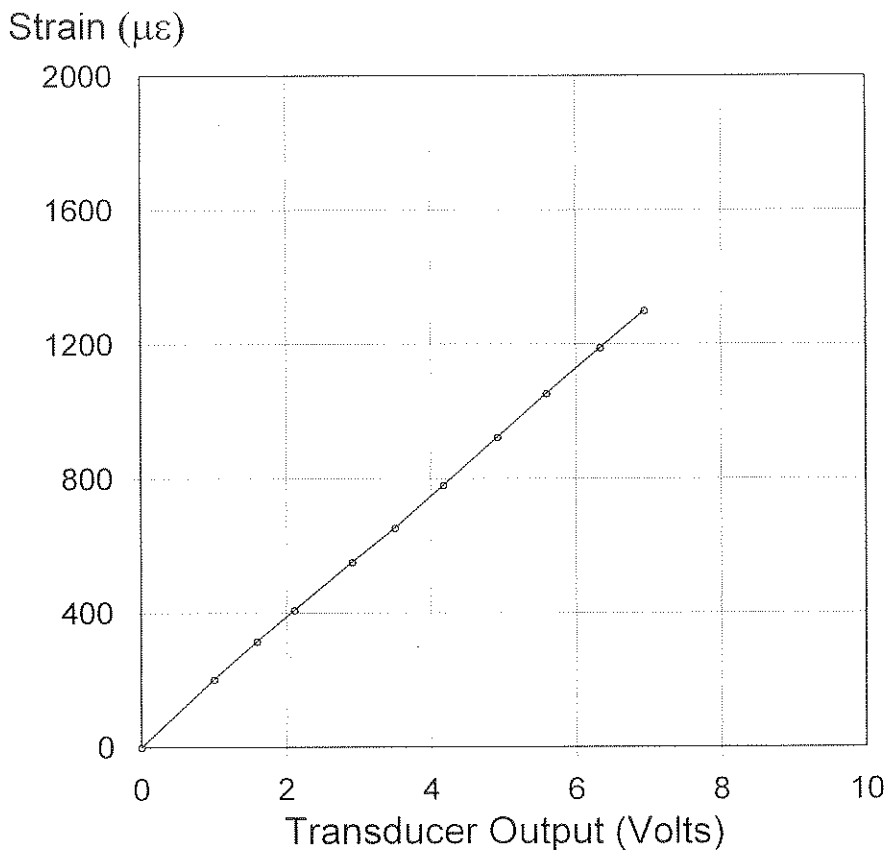

PDA Cal Factor (5.0 V) 93.0 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
203	1.00
316	1.59
409	2.11
551	2.91
653	3.50
779	4.17
922	4.92
1053	5.59
1190	6.33
1300	6.94

Shunt (60.4 K Ω) 2.5 V
 General Factor 322.8 $\mu\epsilon/mVV$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2011 Version 1.5

Smart Sensor? Yes No Smart Chip

Calibrated by: Jenny Pissaloko
 Calibrated on: 04-Jan-2012

Programmed by: JP on: 1-4-12 CRC value 0C39